


201 FOUNDATION PLAN
SCALE: 1/4" = 1'-0"




203 FTG. DET.

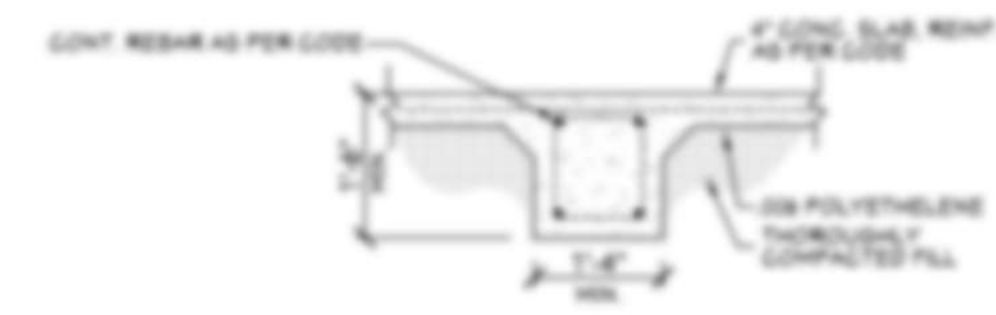


205 FTG. DET.



220 FTG. DET.

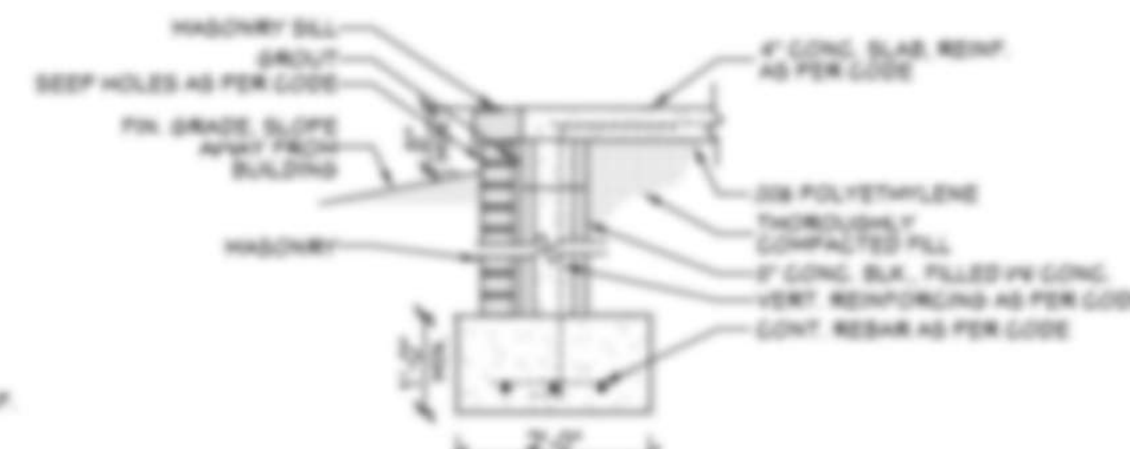

221 FTG. DET.

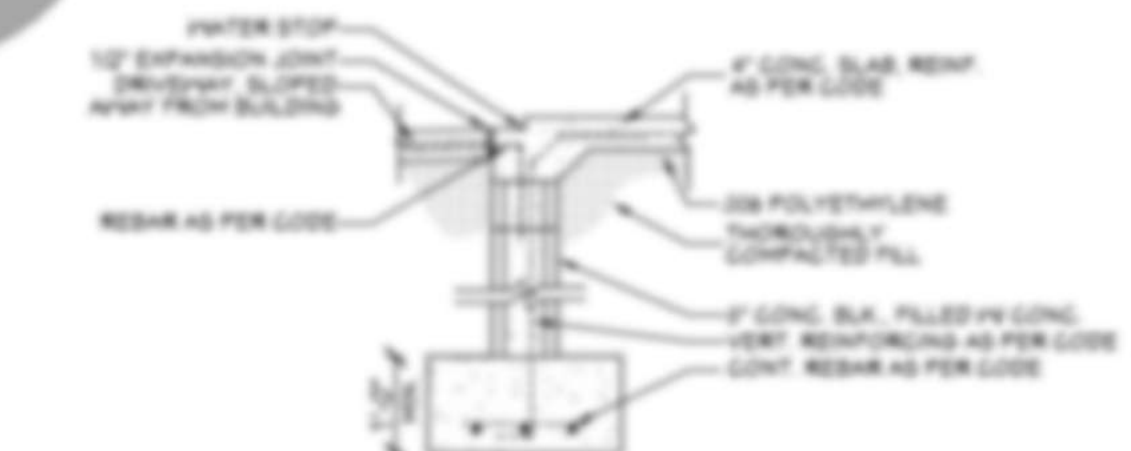

223 FTG. DET.

SLAB FOUNDATION NOTES:

1. ALL FOOTING SIZES AND LOCATIONS TO BE VERIFIED BY A LICENSED STRUCTURAL ENGINEER.
2. CONTRACTOR TO ADAPT PLANS AS REQUIRED TO MEET ALL APPLICABLE CODES AT SITE.
3. CONTRACTOR SHALL VERIFY ALL DIMENSIONS WITH FLOOR PLAN PRIOR TO CONSTRUCTION AND MAKE ANY NECESSARY ADJUSTMENTS.
4. CONTRACTOR TO PROVIDE WATERPROOFING AS REQ'D TO MEET ALL APPLICABLE CODES AND TYPICAL BUILDING PRACTICES.
5. CONCRETE SLABS TO BE 4" (3000 psi MIN.), REINFORCED AS PER CODE OR AS DETERMINED BY LICENSED ENGINEER.

CODE DISCLAIMER:


1. THESE PLANS WERE DESIGNED TO MEET IRC 2012 AT THE TIME OF THEIR CREATION AND MORE SPECIFICALLY THE MINIMAL LOCAL CODES OF THE AREA IN WHICH THEY WERE DESIGNED. IT IS HIGHLY RECOMMENDED THAT THESE PLANS BE REVIEWED BY A LOCAL STRUCTURAL ENGINEER PRIOR TO CONSTRUCTION.
2. BEAMS AND FLOOR JOISTS ARE NOT SIZED DUE TO THE MANY GEOGRAPHIC LOCATIONS THESE PLANS ARE SOLD. THESE ITEMS SHALL BE SIZED BY A LOCAL ENGINEER OR MANUFACTURER.
3. ALL CEILING & FLOOR JOISTS (IF CONVENTIONAL FRAMING) SHOULD BE SIZED USING THE LATEST VERSION OF THE IRC OR APPLICABLE CODES AT SITE TO MEET THE LOCAL REQUIREMENTS SUCH AS SNOW LOADS AND OTHER FACTORS. THE CEILING JOISTS SIZES LABELED (IF PRESENT) WERE SIZED USING THE 2012 IRC AT THE TIME OF THEIR CREATION. THEY MUST BE VERIFIED AND MODIFIED AS REQUIRED TO MEET THE LATEST EDITION OF THE (IRC) INTERNATIONAL RESIDENTIAL CODE.
4. ALL FOUNDATIONS AND FOOTING DETAILS SHALL BE REVIEWED AND APPROVED BY A LOCAL ENGINEER.
5. CONTRACTOR SHALL PROVIDE ALL HIGH WIND STRAPPING AND ANCHOR BOLTS AS REQUIRED BY THE LOCAL CODE REQUIREMENTS AND THE LATEST VERSION OF THE IRC.

Website:
Email: sample@sample.com
Phone: 123.456.7891
Fax: 123.456.7891
N.C.B.D.C.
NATIONAL CONGRESS OF BUILDERS

Pre-Drawn Plan ID:
SAMPLE

Date:
Drawn By:

SHEET NUMBER
2

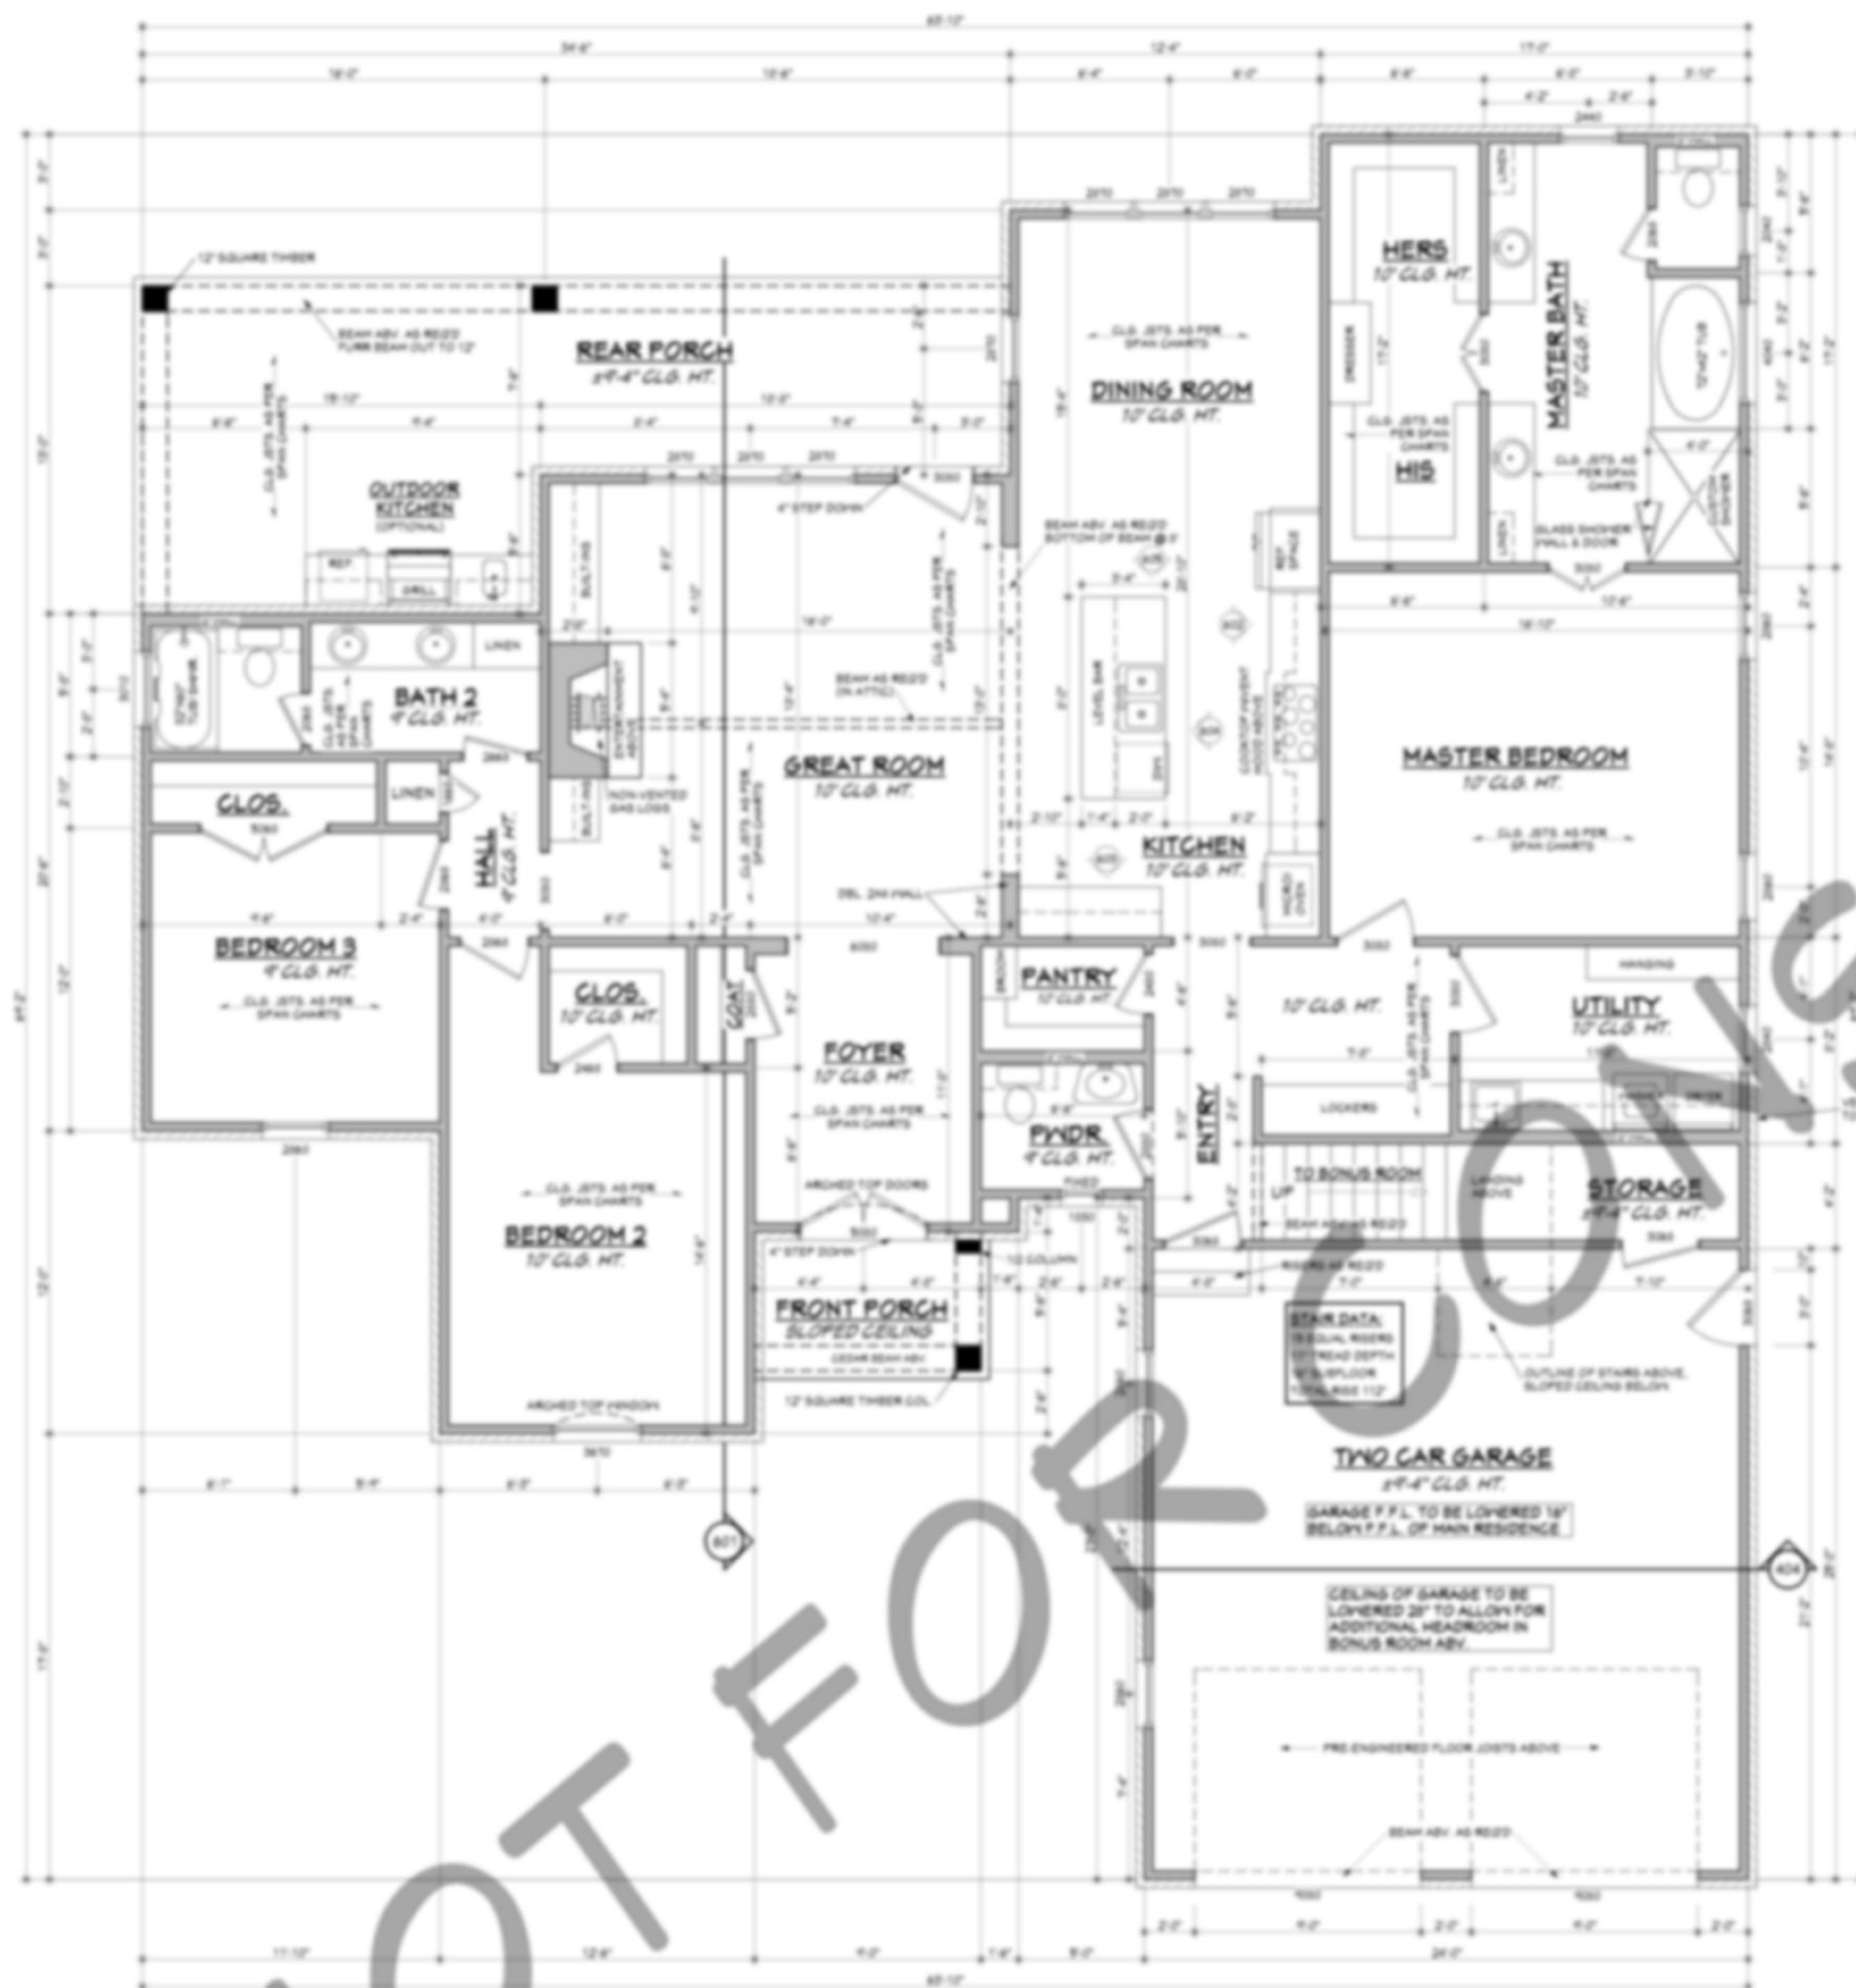

NOTE: CONTRACTOR TO LOCATE WATER HEATER & HVAC AT SITE.

FIRST FLOOR PLAN

SCALE: 1/4" = 1'-0"

AREAS	S.F.	HEATED	NOT INCLUDING MASONRY
2211	S.F.	HEATED	NOT INCLUDING MASONRY
436	S.F.	UNHEATED	BONUS ROOM
50	S.F.	UNHEATED	FRONT PORCH
600	S.F.	UNHEATED	GARAGE
31	S.F.	UNHEATED	STORAGE
345	S.F.	UNHEATED	REAR PORCH
1462	S.F.	TOTAL	UNHEATED
2874	S.F.	TOTAL	UNDER ROOF
MASONRY NOT INCLUDED			

NOTES:

- ALL DIMENSIONS & SITE CONDITIONS TO BE VERIFIED BY CONTRACTOR PRIOR TO CONSTRUCTION.
- ALL FINISHES (INTERIOR & EXTERIOR) TO BE VERIFIED WITH OWNER PRIOR TO CONSTRUCTION.
- VERIFY ALL DOOR AND WINDOW STYLES AND SIZES WITH OWNER PRIOR TO CONSTRUCTION. MANUFACTURER TO SUPPLY ALL ROUGH OPENING SIZES.
- CONTRACTOR TO VERIFY ALL CLEARANCES OF ALL DOORS, WINDOWS AND OTHER ITEMS THAT ARE CAFT PRIOR TO CONSTRUCTION.
- CONTRACTOR TO ADAPT PLANS AS REQUIRED TO MEET ALL APPLICABLE CODES AT SITE.
- ALL BEAMS TO BE SIZED BY A LICENSED STRUCTURAL ENGINEER.
- PORCHES, BALCONIES OR RAISED FLOOR SURFACES LOCATED MORE THAN 30 INCHES ABOVE THE FLOOR GRADE BELOW AT ANY POINT WITHIN 36 INCHES HORIZONTALLY SHALL HAVE GUARDS NOT LESS THAN 36 INCHES IN HEIGHT. OPEN SIDES OF STAIRS WITH A TOTAL RISE OF MORE THAN 30 INCHES ABOVE THE FLOOR GRADE BELOW SHALL HAVE GUARDS NOT LESS THAN 34 INCHES IN HEIGHT MEASURED VERTICALLY FROM T NOSING OF THE TREADS. INSECT SCREENING SHALL NOT BE CONSIDERED AS A GUARD. IRC 2012, R312.1.1 & R312.1.2
- M1305.1.3 APPLIANCES IN ATTICS. ATTICS CONTAINING APPLIANCES SHALL BE PROVIDED WITH AN OPENING AND A CLEAR AND UNOBSTRUCTED PASSAGEWAY LARGE ENOUGH TO ALLOW REMOVAL OF THE LARGEST APPLIANCE, BUT NOT LESS THAN 30 INCHES HIGH AND 22 INCHES WIDE AND NOT MORE THAN FEET LONG MEASURED ALONG THE CENTERLINE OF THE PASSAGEWAY FROM THE OPENING TO THE APPLIANCE. THE PASSAGEWAY SHALL HAVE CONTINUOUS SOLID FLOORING IN ACCORDANCE WITH CHAPTER 5 NOT LESS THAN 24 INCHES WIDE. A LEVEL SERVICE SPACE AT LEAST 30 INCHES DEEP AND 30 INCHES WIDE SHALL BE PRESENT ALONG ALL SIDES OF THE APPLIANCE WHERE ACCESS IS REQUIRED. THE CLEAR ACCESS OPENING DIMENSIONS SHALL BE A MINIMUM OF 20 INCHES BY 30 INCHES, AND LARGE ENOUGH TO ALLOW REMOVAL OF THE LARGEST APPLIANCE. EXCEPTIONS:
 a. THE PASSAGEWAY AND LEVEL SERVICE SPACE ARE NOT REQUIRED WHERE THE APPLIANCE CAN BE SERVICED AND REMOVED THROUGH THE REQUIRED OPENING.
 b. WHERE THE PASSAGEWAY IS UNOBSTRUCTED AND NOT LESS THAN 6 FEET HIGH AND 22 INCHES WIDE FOR ITS ENTIRE LENGTH, THE PASSAGEWAY SHALL BE NOT MORE THAN 50 FEET LONG.
- APPLIANCE ACCESS FOR INSPECTION SERVICE, REPAIR AND REPLACEMENT. APPLIANCES SHALL BE ACCESSIBLE FOR INSPECTION, SERVICE, REPAIR AND REPLACEMENT WITHOUT REMOVING PERMANENT CONSTRUCTION. OTHER APPLIANCES, OR ANY OTHER PIPING OR DUCTS NOT CONNECTED TO THE APPLIANCES INSPECTED, SERVICED, REPAIRED OR REPLACED, A LEVEL WORKING SPACE AT LEAST 30 INCHES DEEP AND 30 INCHES WIDE SHALL BE PROVIDED IN FRONT OF THE CONTROL SIC TO SERVICE AN APPLIANCE. INSTALLATION OF ROOM HEATERS SHALL BE PERMITTED WITH AT LEAST AN 18-INCH WORKING SPACE. A PLATFORM SHALL NOT BE REQUIRED FOR ROOM HEATERS.
- M1305.1.1 FURNACES AND AIR HANDLERS. FURNACES AND AIR HANDLERS WITHIN COMPARTMENTS OR ALCOVE SHALL HAVE A MINIMUM WORKING SPACE CLEARANCE OF 5 INCHES ALONG THE SIDES, BACK AND TOP WITH TOTAL WIDTH OF THE ENCLOSING SPACE BEING AT LEAST 12 INCHES WIDER THAN THE FURNACE OR AIR HANDLER. FURNACES HAVING A FIREBOX OPEN TO THE ATMOSPHERE SHALL HAVE AT LEAST A 6-INCH FLOOR SPACE ALONG THE FRONT COMBUSTION CHAMBER SIDE. COMBUSTION AIR OPENINGS AT THE REAR OR SIDE OF THE COMPARTMENT SHALL COMPLY WITH THE REQUIREMENTS OF CHAPTER 11. EXCEPTION: THIS SECTION SHALL NOT APPLY TO REPLACEMENT APPLIANCES INSTALLED IN EXISTING COMPARTMENTS AND ALCOVES WHERE THE WORKING SPACE CLEARANCES ARE IN ACCORDANCE WITH THE EQUIPMENT OR APPLIANCE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- ALL SLEEPING ROOMS TO HAVE AN EXTERIOR ACCESS THROUGH A DOOR OR WINDOW WITH A MINIMUM 5.7 SQUARE FEET NET CLEAR OPENING AS PER IRC 2012 R310.1.1. EXCEPTION: GRADE FLOOR OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 9 SQUARE FEET. MAXIMUM SILL HEIGHT TO BE 44 INCHES. MINIMUM NET CLEAR OPENING HEIGHT TO BE 24 INCHES. MINIMUM NET CLEAR OPENING WIDTH TO BE 20 INCHES.
- ALL RETURN AIR GRILLS ARE TO BE LOCATED TO COMPLY WITH SECTION M1602 OF THE IRC 2012.
- ALL SQUARE FOOTAGE MEASUREMENTS ARE APPROXIMATE AND MAY DIFFER FROM ACTUAL CONSTRUCTION RESIDENCE OR BUILDING.
- FIRE SPRINKLER SYSTEM TO BE DESIGNED AND INSTALLED (IF REQUIRED BY LOCAL CODES) AS PER THE 2012 AND BY A LICENSED PROFESSIONAL IN THE AREA OF CONSTRUCTION.
- ALL BATHROOM EXHAUST VENTS SHALL BE VENTED DIRECTLY TO THE EXTERIOR OF THE HOME AND NOT INTO THE ATTIC. IRC 2012, M1501.2



BONUS FLOOR PLAN

SCALE: 1/4" = 1'-0"


Website:
 Email: sample@sample.com
 Phone: 123.456.7891
 Fax: 123.456.7891

N.C.B.D.C.
 NATIONAL CONFERENCE OF BUILDING DRAWERS & ARCHITECTS

Pre-Drawn Plan ID:
SAMPLE

Date:
 Drawn By:
 Project Name:


SHEET NUMBER
3

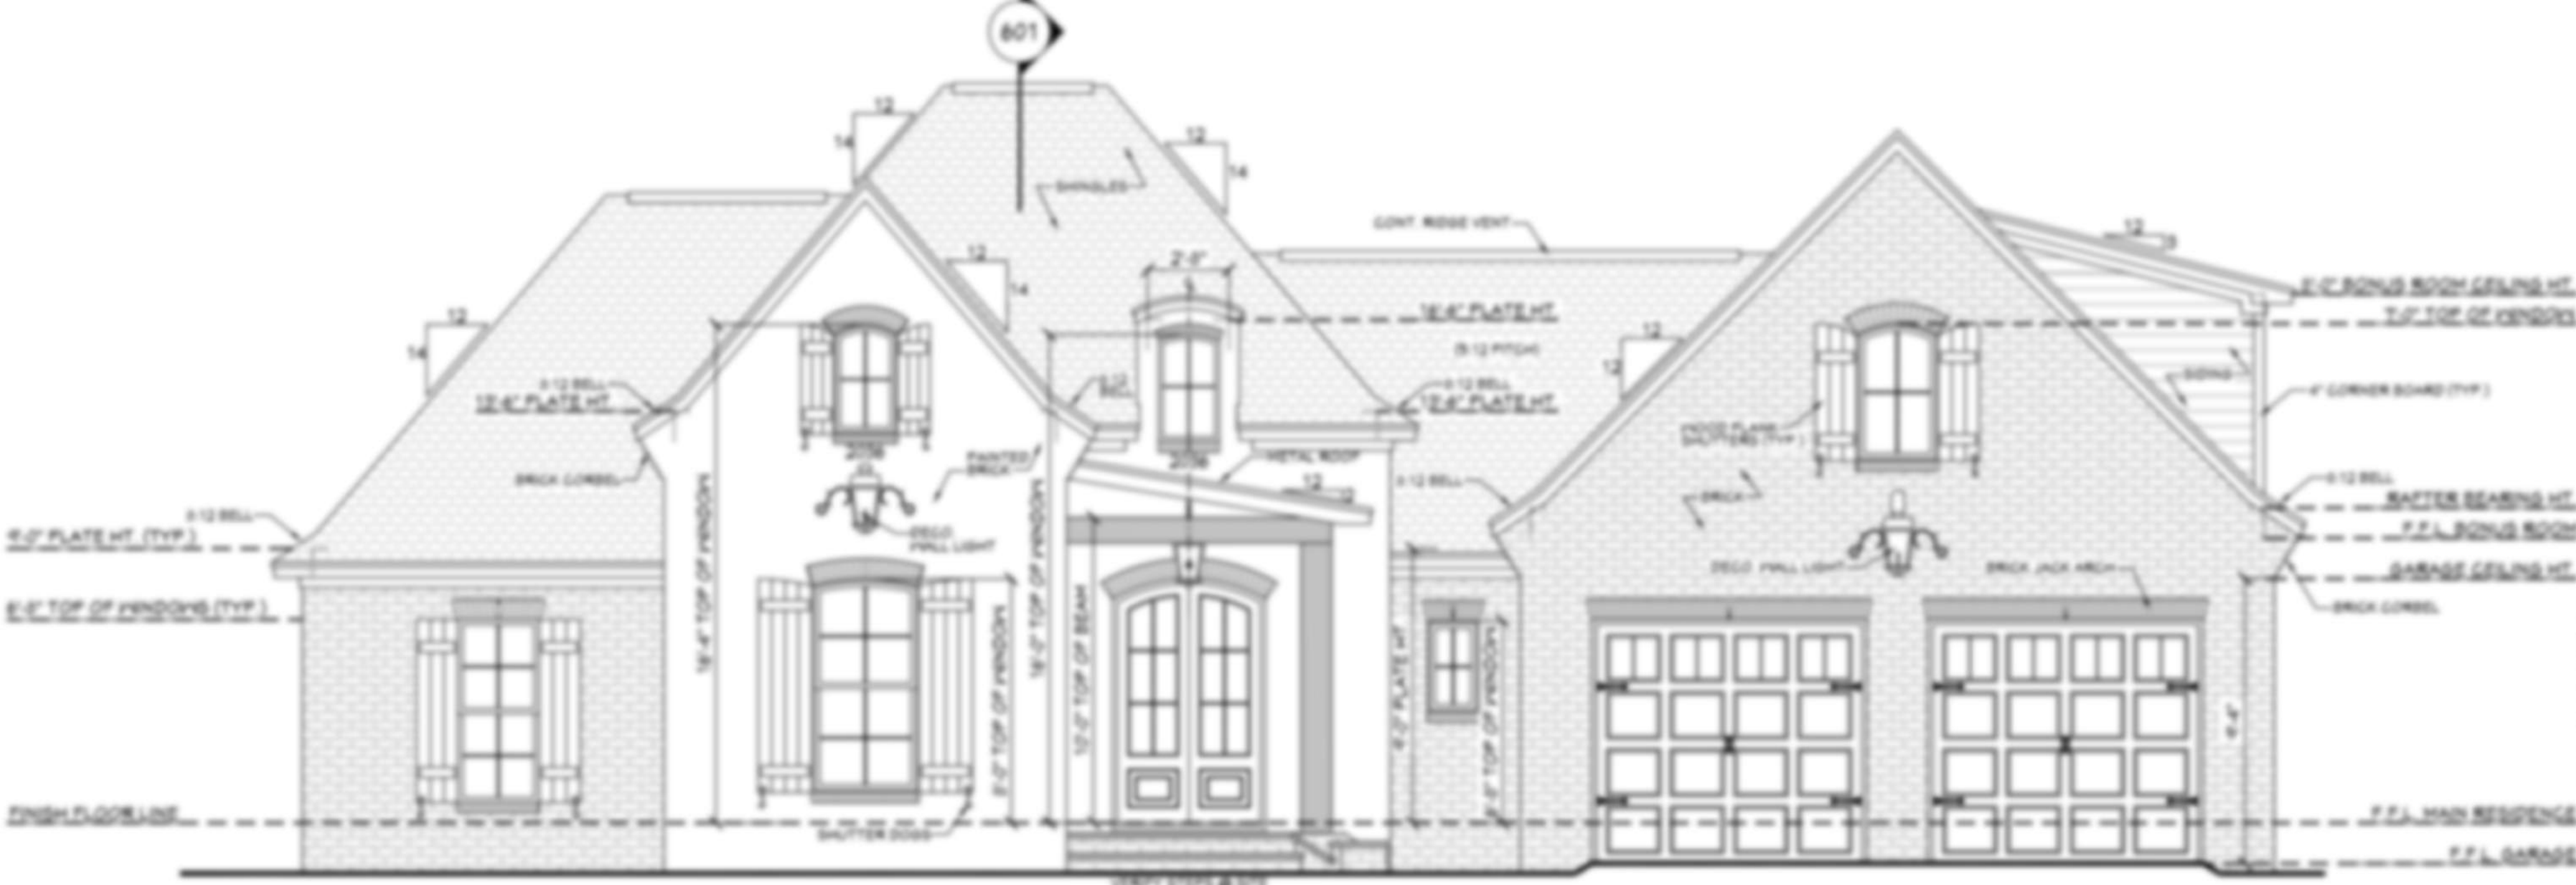

401 FRONT VIEW
SCALE 1/4" = 1'-0"


EXTERIOR ELEVATION NOTES:

1. CONTRACTOR TO VERIFY ALL WINDOW AND DOOR STYLES AND SIZES WITH OWNER PRIOR TO CONSTRUCTION.
2. PROVIDE STEPS AND GUARD RAILS AS PER CODE BASED ON SITE CONDITIONS.
3. GROUND LINES SHOWN FOR REFERENCE ONLY AND VARY DEPENDING ON SITE CONDITIONS.
4. ALL FINISH MATERIALS TO BE VERIFIED WITH OWNER PRIOR TO CONSTRUCTION.
5. REFER TO TYPICAL WALL DETAIL FOR FRAMING METHODS AND OTHER MISC. INFORMATION.
6. CONTRACTOR TO PROVIDE ADEQUATE ROOF VENTILATION AS REQ'D BY CURRENT CODES.

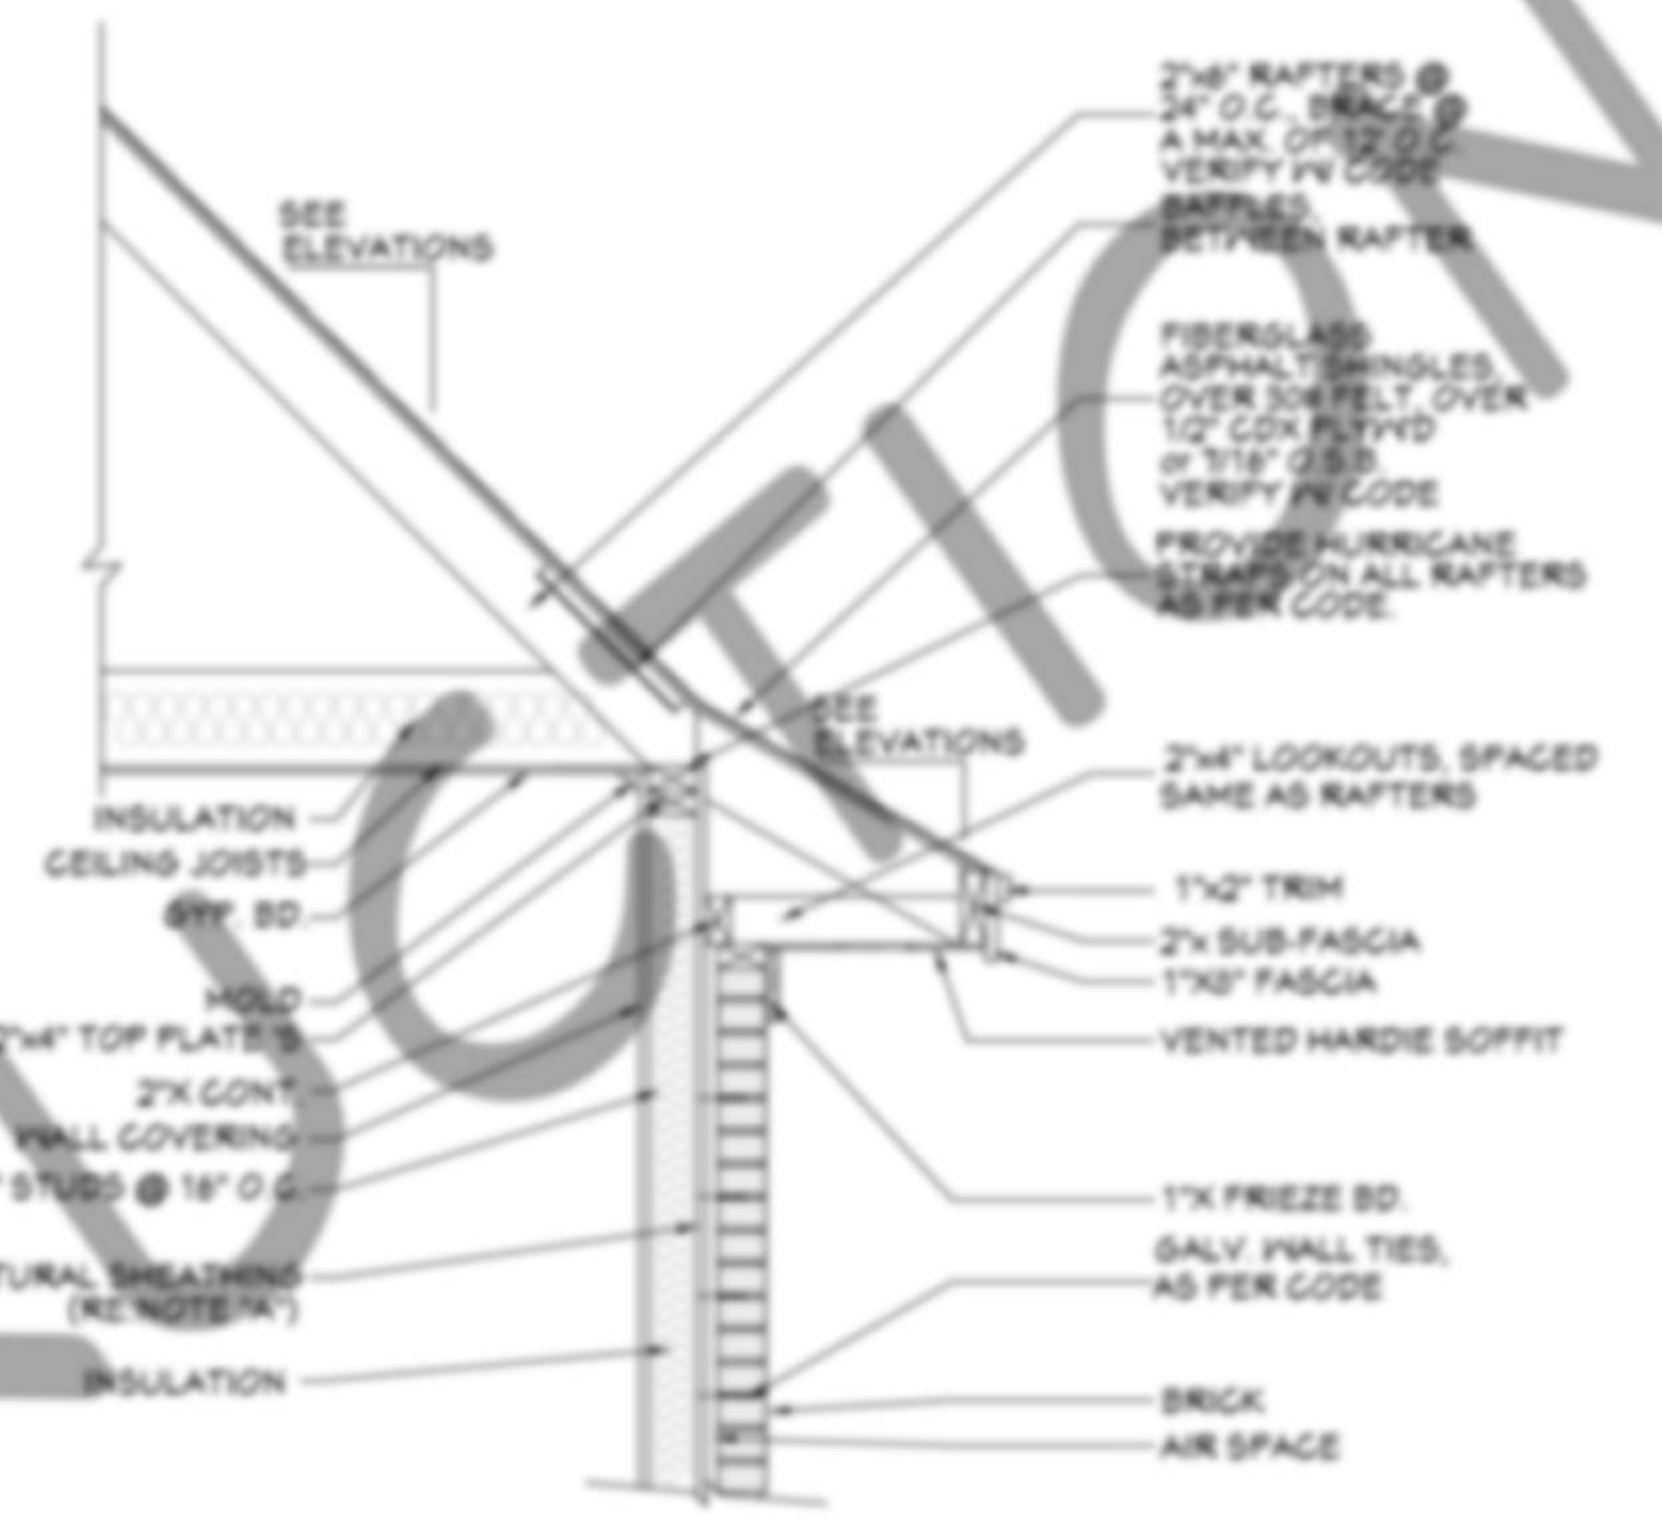


403 DUAL PITCH CORNICE DETAIL
SCALE 3/4" = 1'-0"

405 BRICK CORBEL DETAIL
SCALE NTS

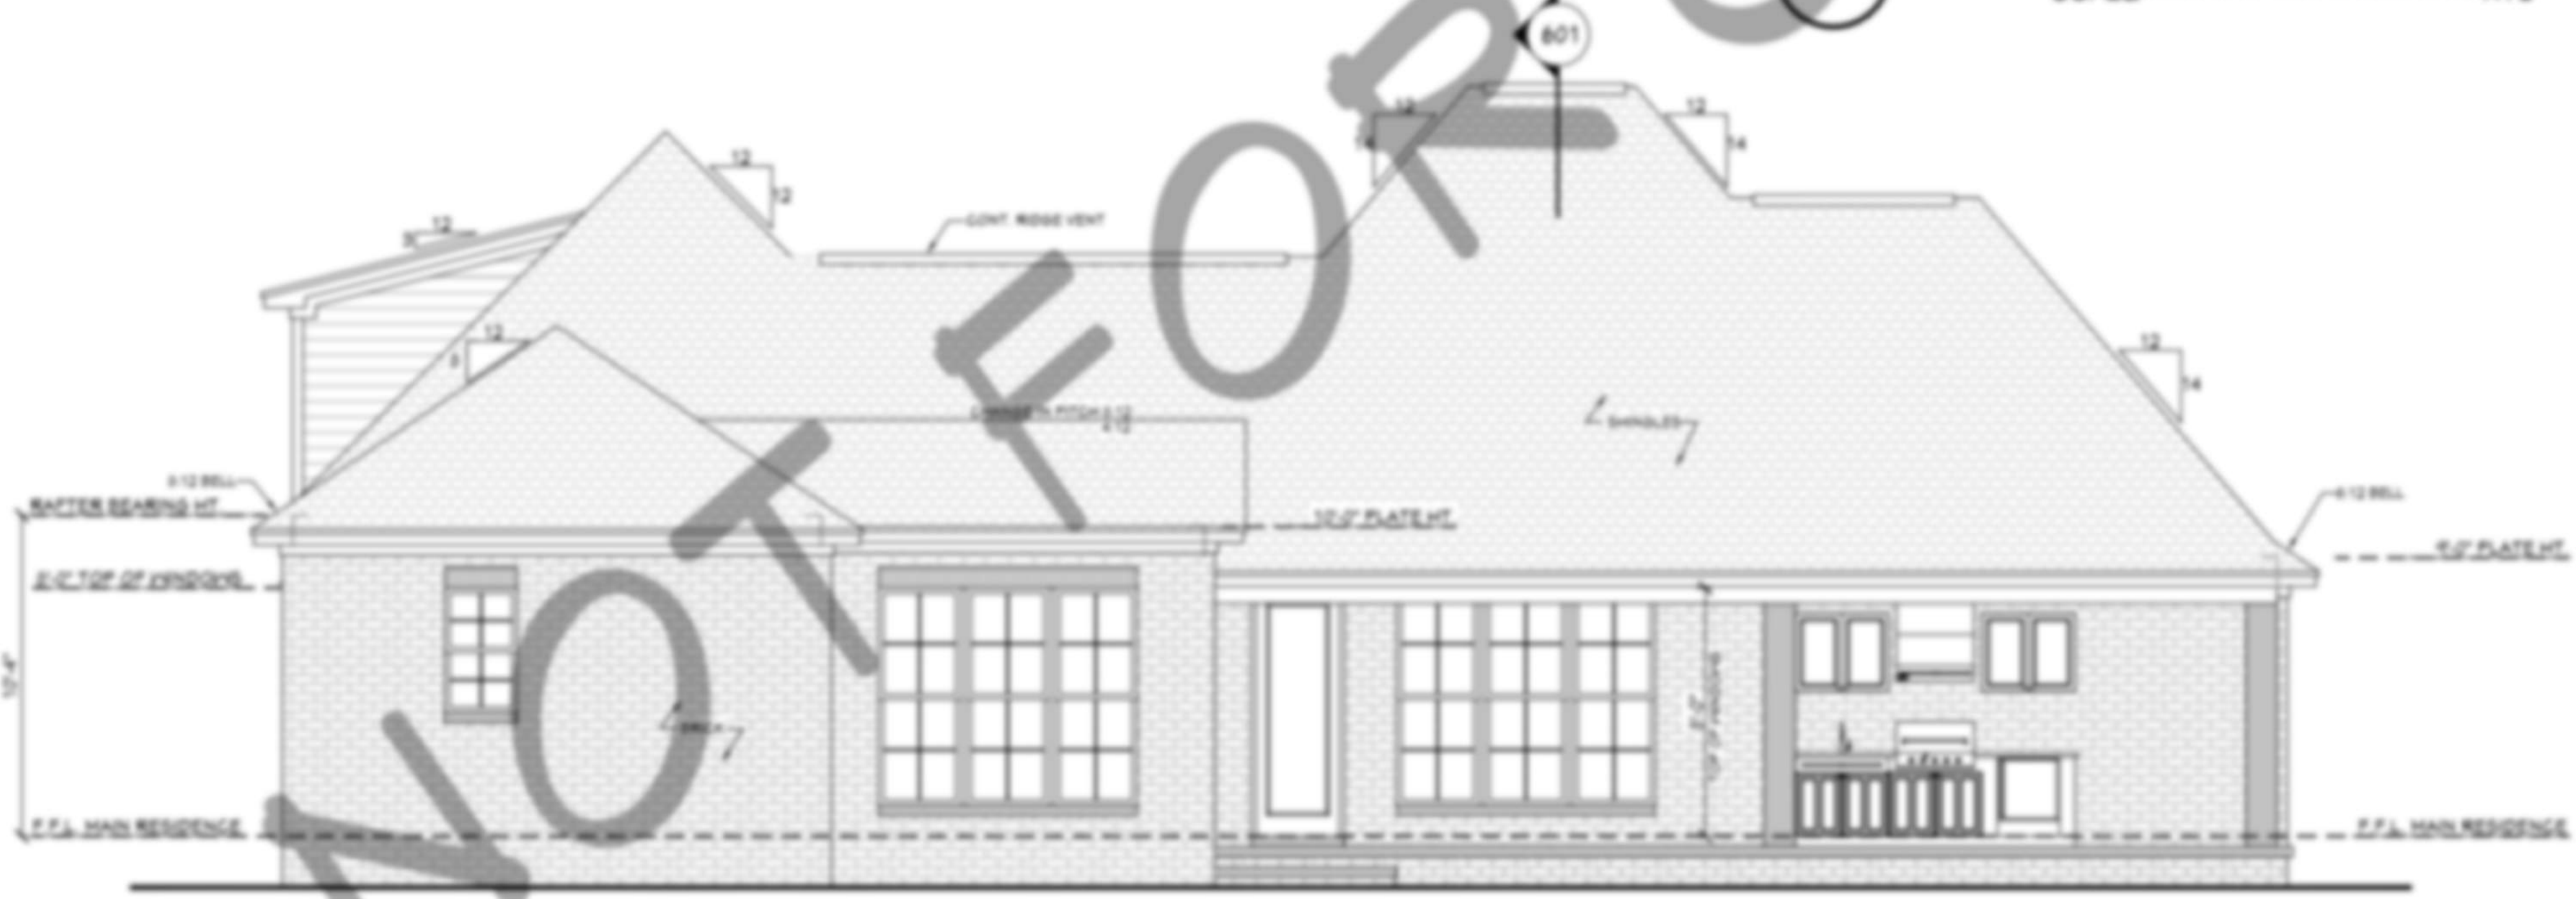

402 REAR VIEW
SCALE 1/4" = 1'-0"

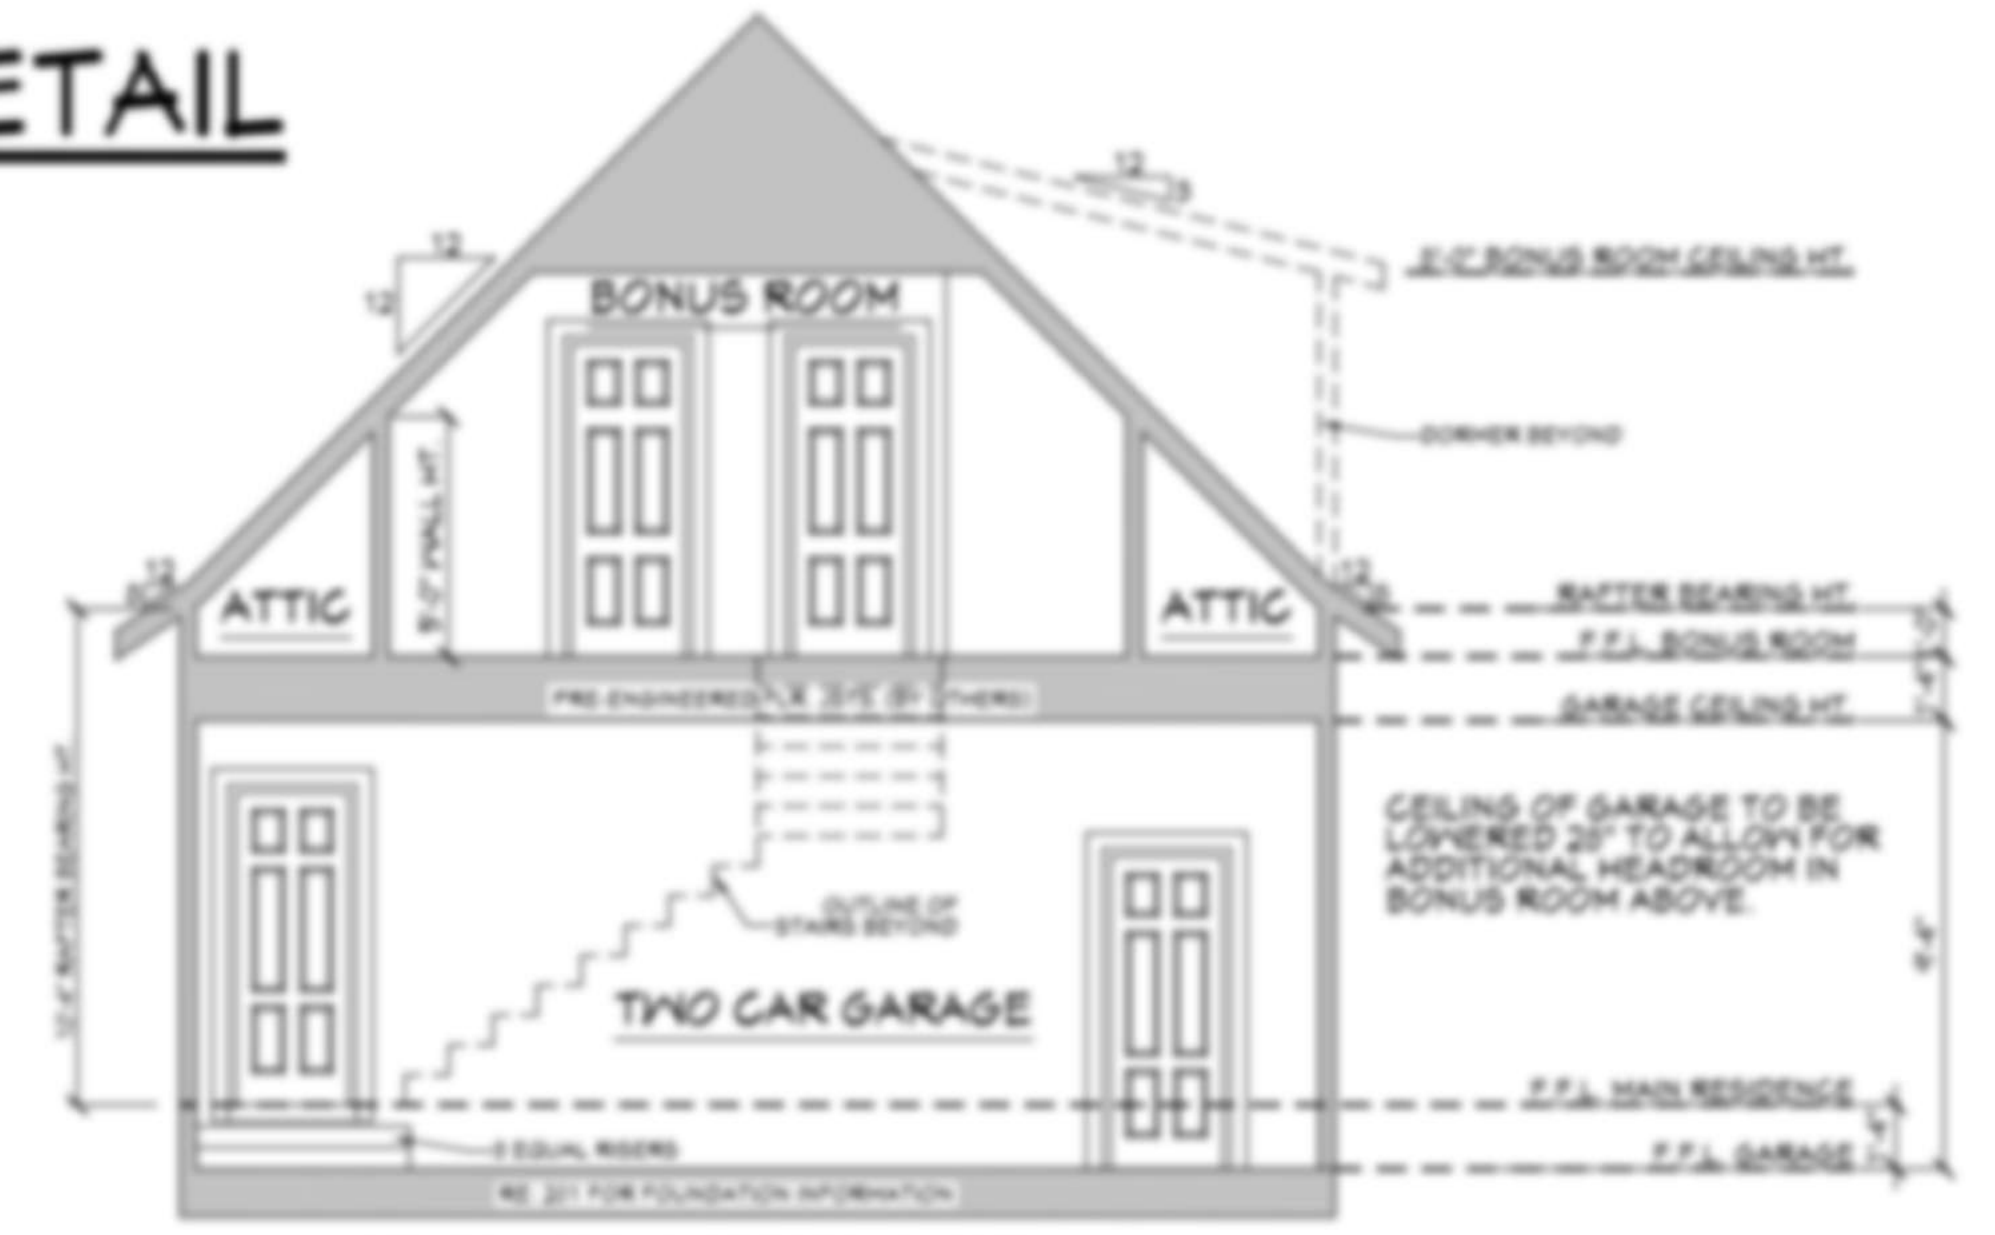

404 GARAGE SECTION
SCALE 1/4" = 1'-0"

Website:
Email: sample@sample.com
Phone: 123.456.7891
Fax: 123.456.7891




Pre-Drawn Plan ID:
SAMPLE

Date:
Drawn By:


SHEET NUMBER
4

EXTERIOR ELEVATION NOTES:


1. CONTRACTOR TO VERIFY ALL WINDOW AND DOOR STYLES AND SIZES WITH OWNER PRIOR TO CONSTRUCTION.
2. PROVIDE STEPS AND GUARD RAILS AS PER CODE BASED ON SITE CONDITIONS.
3. GROUND LINES SHOWN FOR REFERENCE ONLY AND VARY DEPENDING ON SITE CONDITIONS.
4. ALL FINISH MATERIALS TO BE VERIFIED WITH OWNER PRIOR TO CONSTRUCTION.
5. REFER TO TYPICAL WALL DETAIL FOR FRAMING METHODS AND OTHER MISC. INFORMATION.
6. CONTRACTOR TO PROVIDE ADEQUATE ROOF VENTILATION AS REQ'D BY CURRENT CODES.

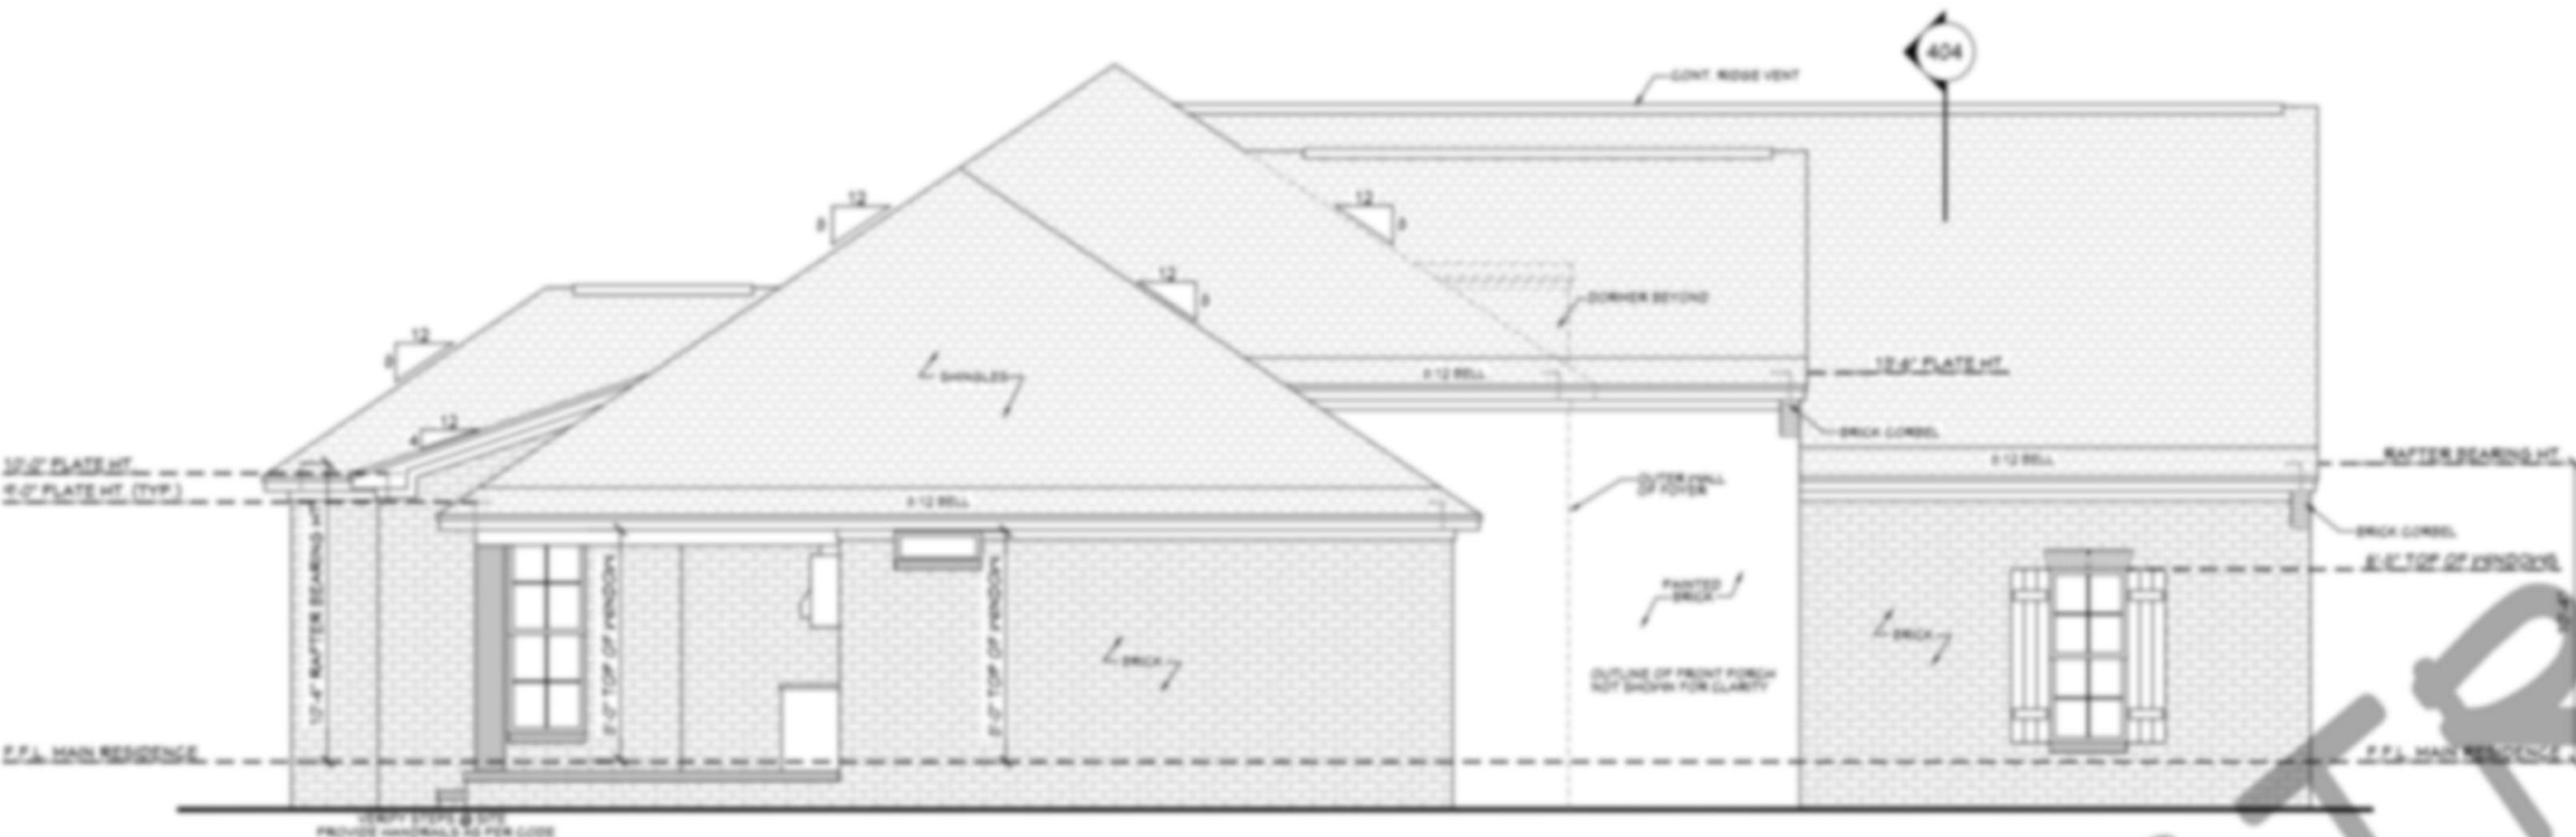

501 LEFT VIEW
SCALE 1/4" = 1'-0"

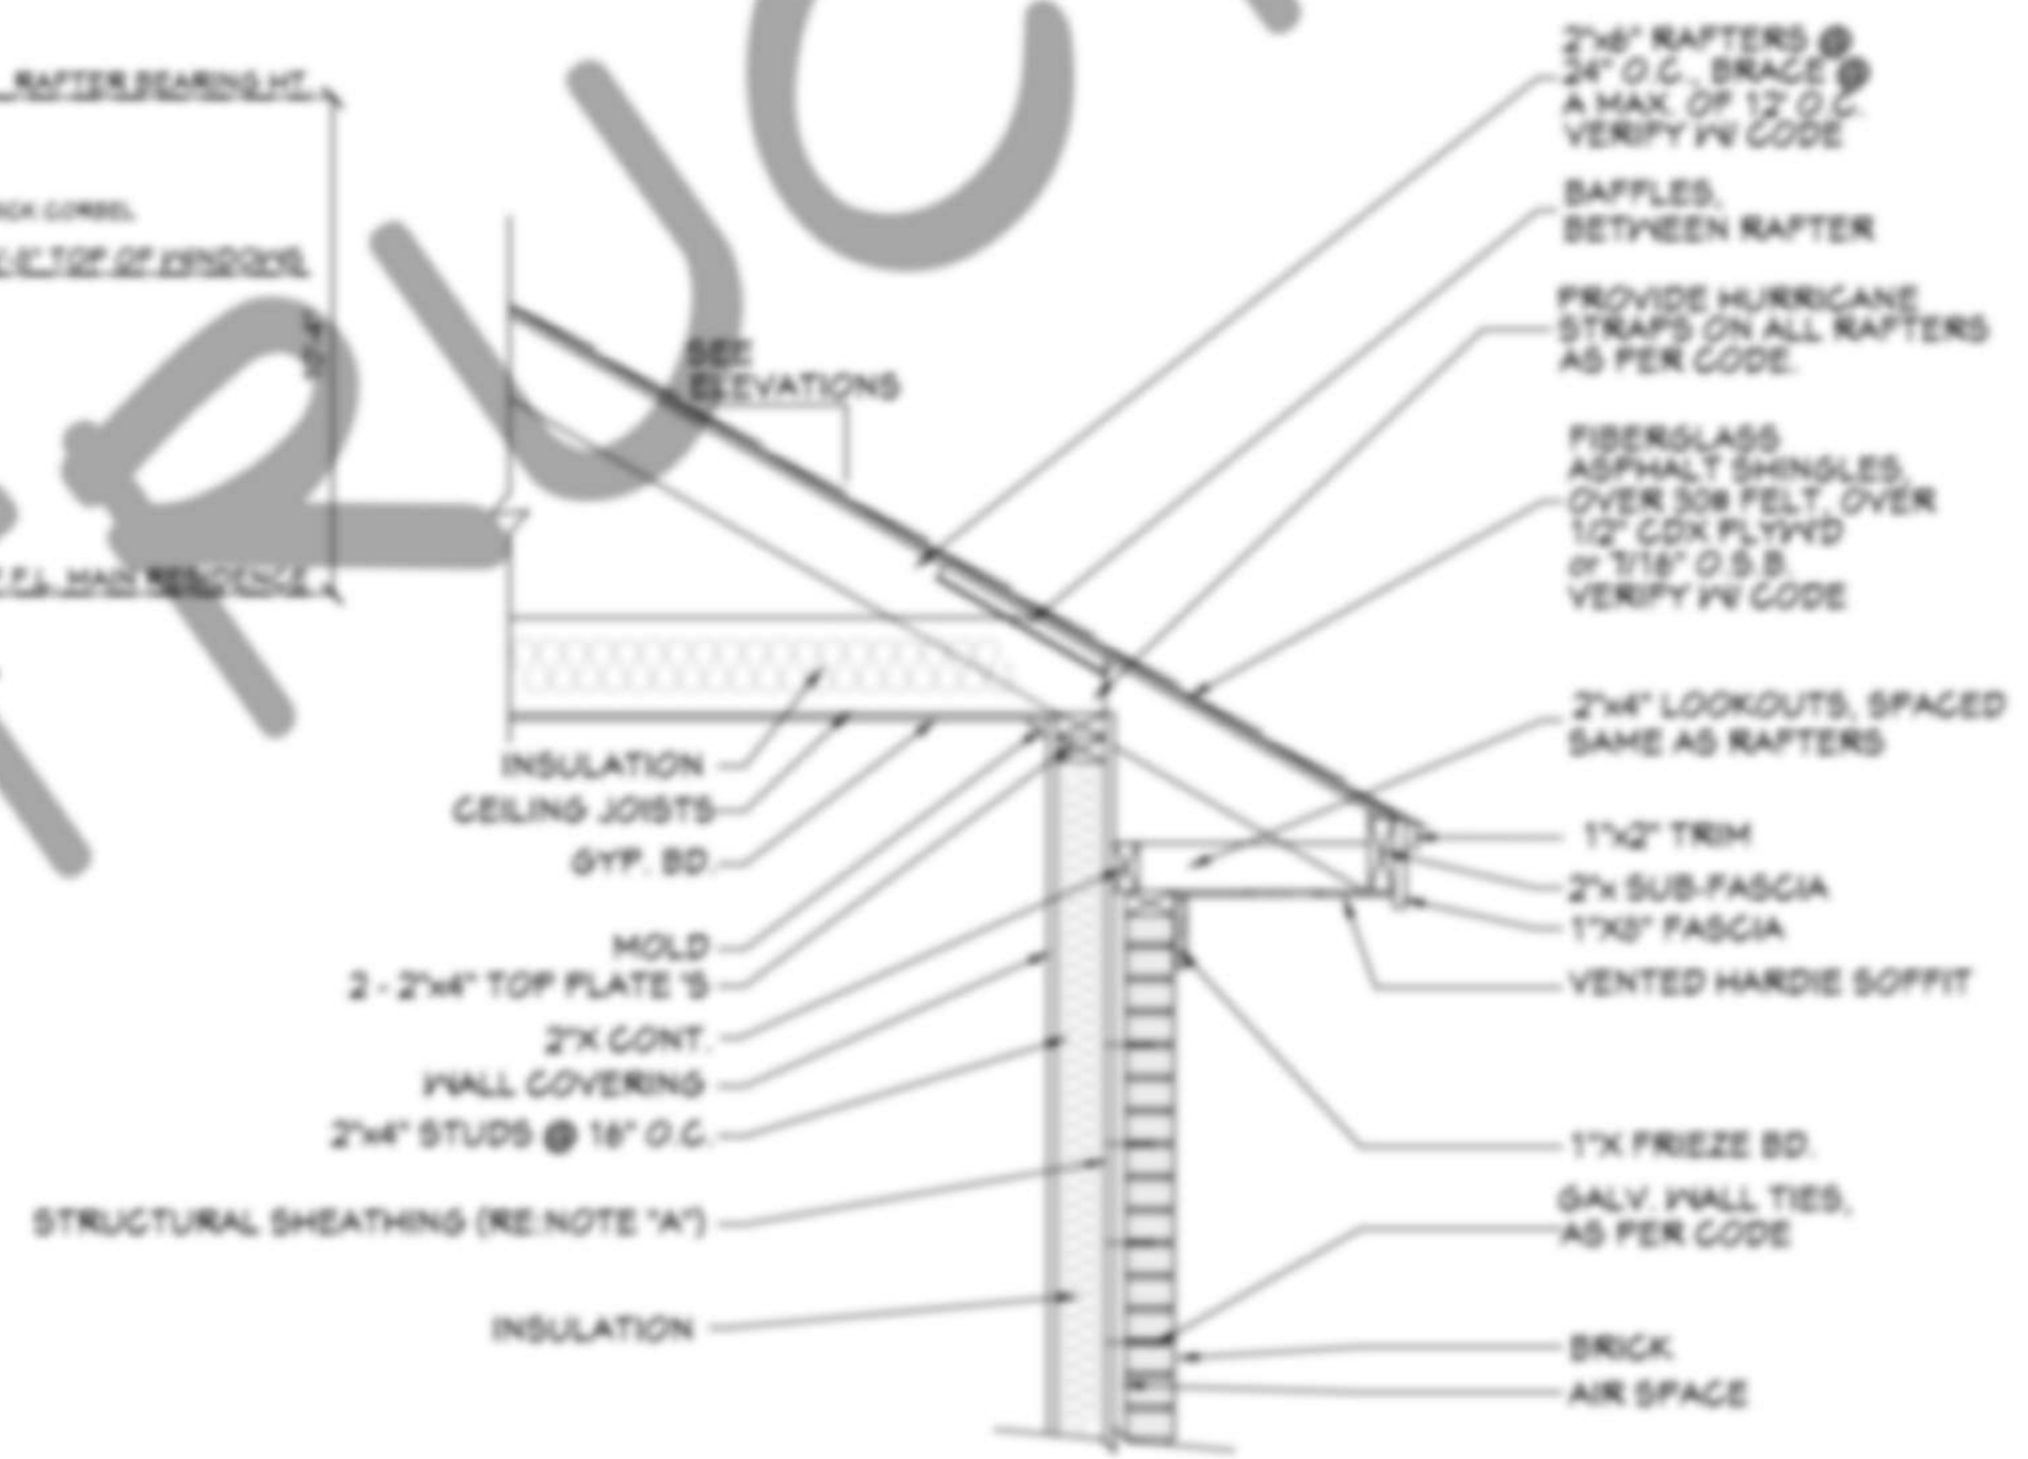

503 TYP. CORNICE DETAIL
SCALE 3/4" = 1'-0"

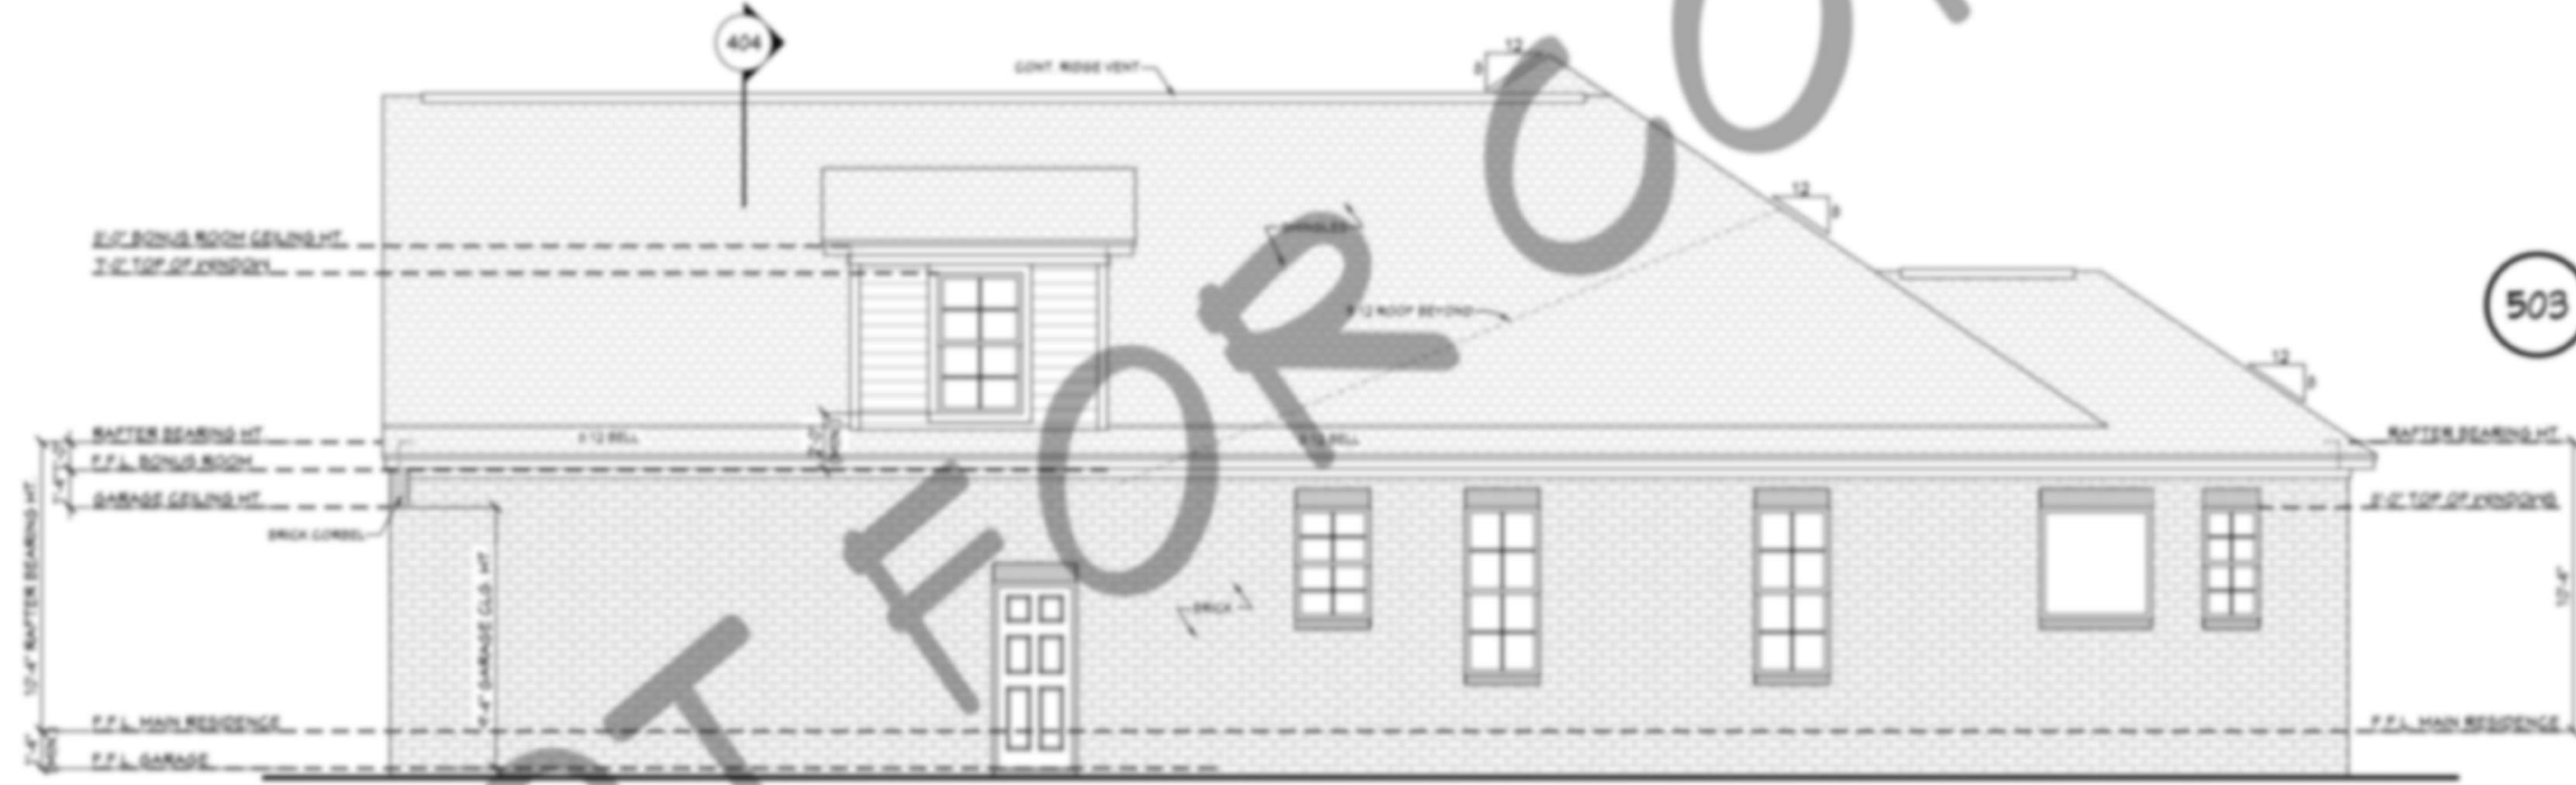

502 RIGHT VIEW
SCALE 1/4" = 1'-0"

Website:

Email: sample@sample.com

Phone: 123.456.7891

Fax: 123.456.7891



Pre-Drawn Plan ID:


SAMPLE

Date:

Drawn By:



SHEET NUMBER

5

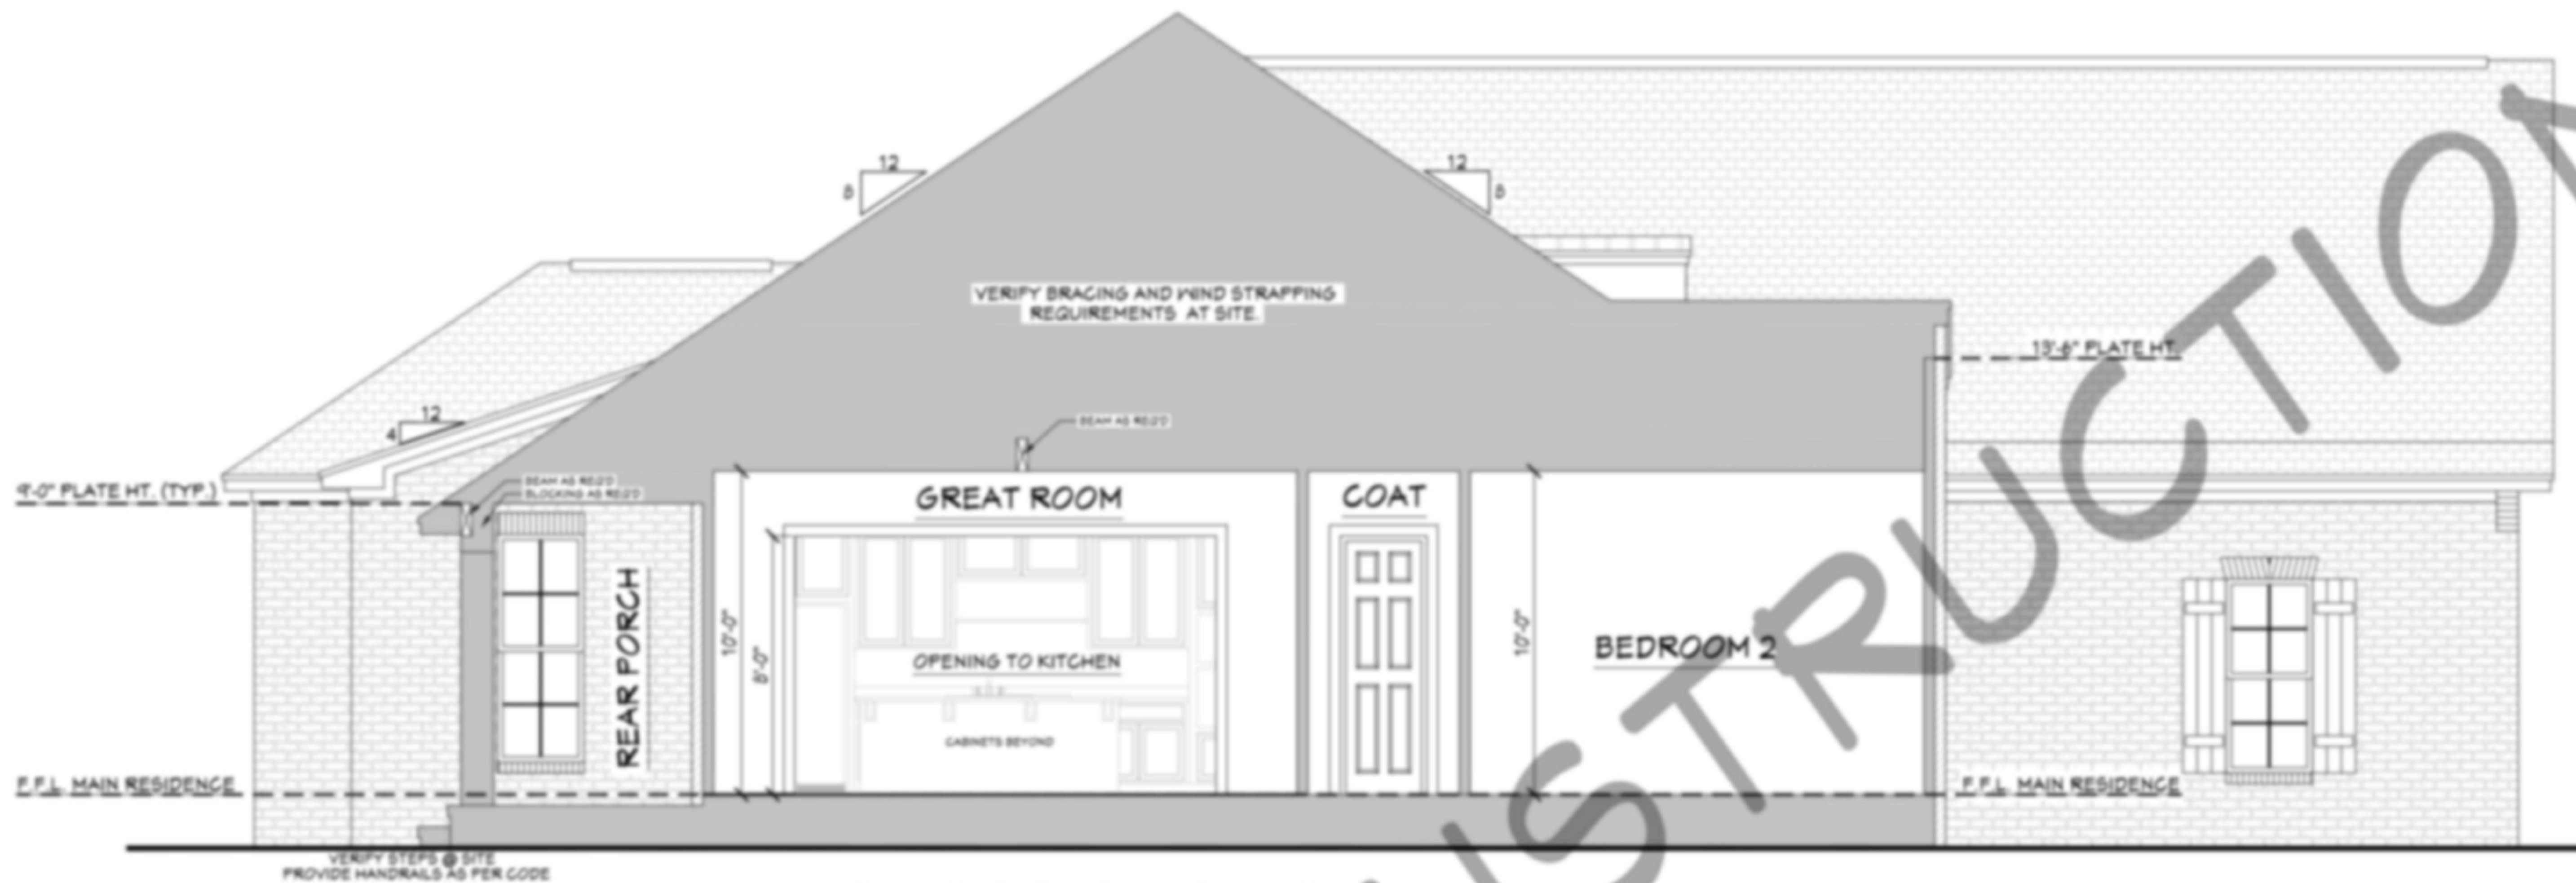


601 CROSS SECTION
SCALE: 3/8"=1'-0"

- CROSS SECTION NOTES:**
1. CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE CODES AT SITE.
 2. ALL RIDGE BEAMS, HIP RAFTERS, & VALLEY RAFTERS TO BE 2" x 10", OR AS REG'D BY ENGINEER.
 3. CONTRACTOR TO PROVIDE RAFTER BRACING TO MEET APPLICABLE CODES.
 4. CONTRACTOR TO THOROUGHLY WATERPROOF ALL EXTERIOR INTERSECTIONS AS PER CODE AND TYPICAL BUILDING PRACTICES.
 5. ALL BEAMS TO BE SIZED BY A LICENSED STRUCTURAL ENGINEER.
 6. ALL LUMBER SIZES AND SPACING TO BE VERIFIED BY CONTRACTOR PRIOR TO CONSTRUCTION.
 7. CONTRACTOR TO PROVIDE ADEQUATE ROOF VENTILATION AS REG'D. BY CURRENT CODES.

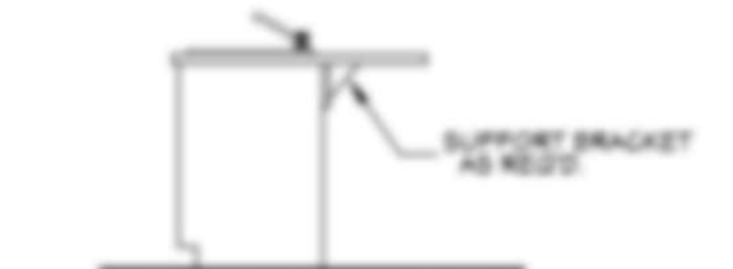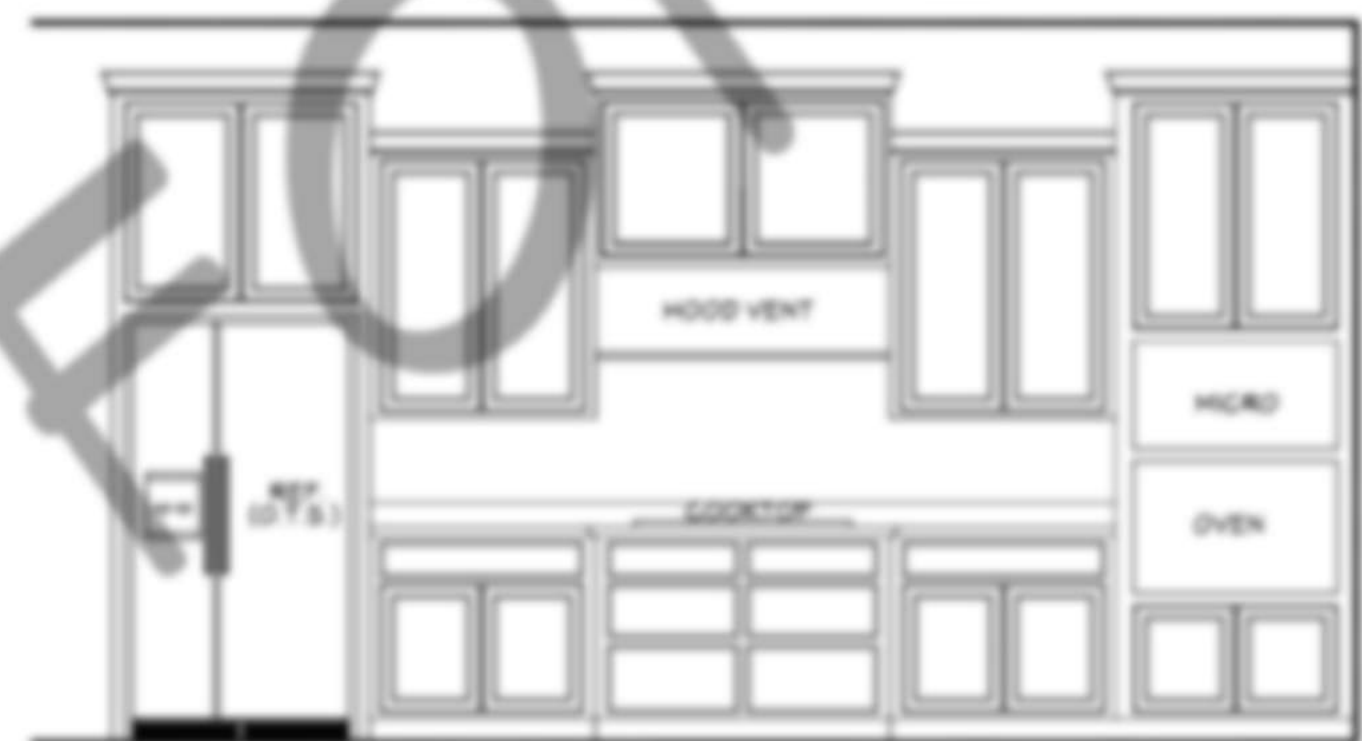

602 KITCHEN SCALE: 3/8"=1'-0"
603 KITCHEN SCALE: 3/8"=1'-0"
604 KITCHEN SCALE: 3/8"=1'-0"
605 KITCHEN SCALE: 3/8"=1'-0"

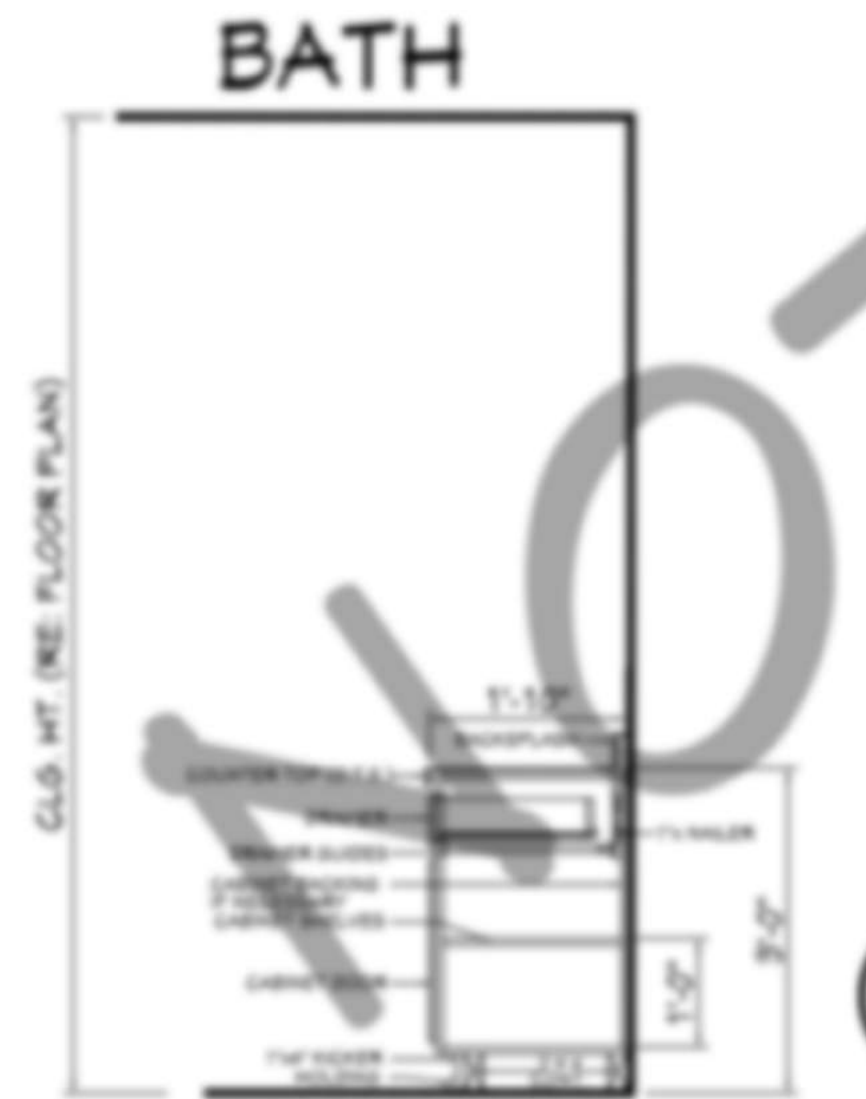


606 TYP. CAB. SECTIONS
SCALE: N.T.S.

Website:
Email: sample@sample.com
Phone: 123.456.7891
Fax: 123.456.7891
N·C·B·D·C
NATIONAL COUNCIL OF BUILDING DRAWING CONTRACTORS

Pre-Drawn Plan ID:
SAMPLE

Date:
Drawn By:

SHEET NUMBER
6

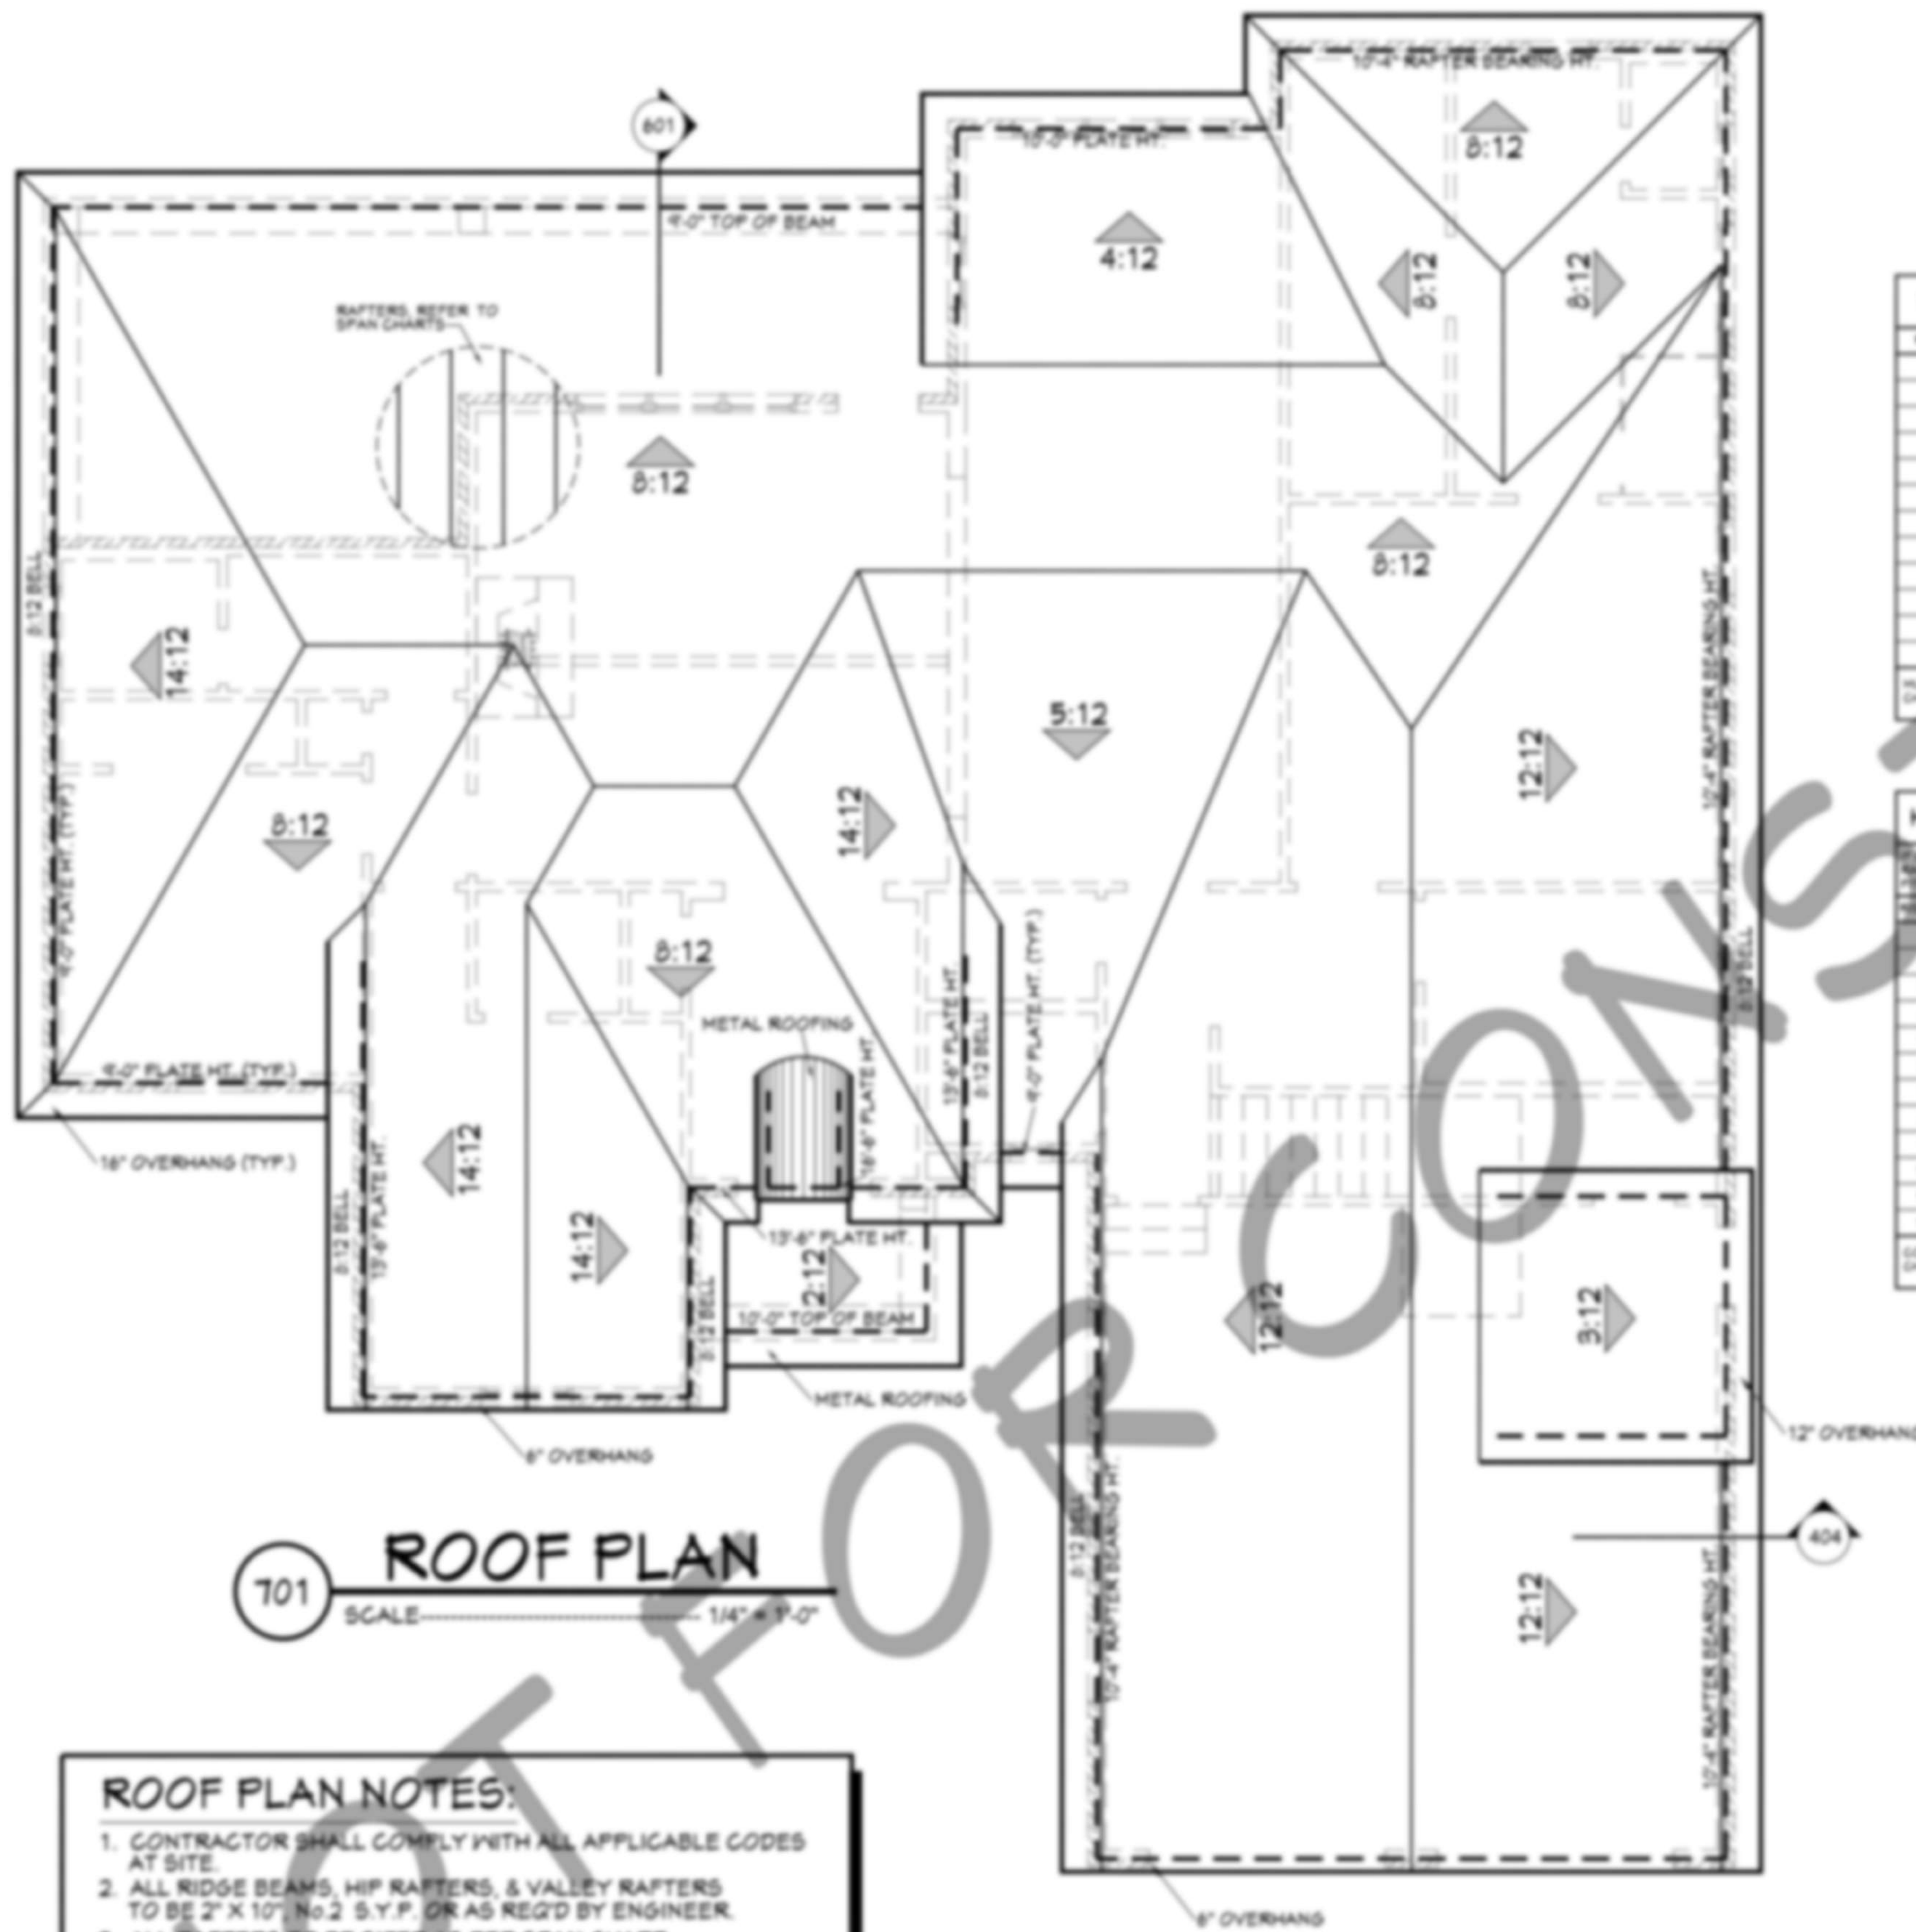

701 ROOF PLAN
SCALE 1/4" = 1'-0"

CEILING JOIST SPANS
CEILING JOIST SPANS FOR SOUTHERN PINE SPECIES
UNINHABITABLE ATTICS WITHOUT STORAGE, LIVE LOAD = 20psf, LL = 30psf
DEAD LOAD = 10psf

IF HABITABLE ATTIC SPACE OR STORAGE IS DESIRED, REFER TO THE INTERNATIONAL RESIDENTIAL CODE, SPAN TABLE.

SIZE	SPACING (INCHES)	VISUALLY GRADED #2 SOUTHERN PINE (MAXIMUM JOIST SPAN)
2 x 4	12.0	4.0
	16.0	6.0
	19.2	8.0
2 x 6	12.0	8.1
	16.0	12.0
	19.2	15.0
2 x 8	12.0	13.1
	16.0	19.0
	19.2	25.1
2 x 10	12.0	15.1
	16.0	22.0
	19.2	28.0

NOTES:
The above tables are based on the 2012 New Design Values set forth by Southern Forest Products Association.

RAFTER LENGTH CHART

ROOF PITCH	FACTOR
8:12	1.06
10:12	1.07
12:12	1.10
14:12	1.14
16:12	1.17
18:12	1.20
20:12	1.24
24:12	1.30
30:12	1.40
36:12	1.50
48:12	1.75

RAFTER LENGTH CHART FOR SOUTHERN PINE SPECIES
CHECK LOCAL CODES FOR RATED RAFTER LENGTHS

HIP/VALLEY CONVERSION

COMMON RAFTER SLOPE	THEN HIP/VALLEY RAFTER SLOPE
8:12	11:12
10:12	13:12
12:12	15:12
14:12	17:12
16:12	19:12
18:12	21:12
20:12	23:12
24:12	27:12
30:12	33:12
36:12	39:12

CONVERSION CHART FOR SHIP-TO-ROOFS ONLY
CHART DOES NOT APPLY FOR DUAL PITCH ROOFS

RAFTER SPANS
RAFTER SPANS FOR SOUTHERN PINE SPECIES
LIVE LOAD=30psf, LL(240) DEAD LOAD = 10psf
CD = 1.15 (SNOW)

SIZE	SPACING (INCHES)	SPANS (MAXIMUM RAFTER SPAN BETWEEN BRACINGS) (FT. - IN.)
2 x 6	12.0	12-11
	16.0	11-2
	19.2	10-2
	24.0	4-2
2 x 8	12.0	16-4
	16.0	14-2
	19.2	12-11
	24.0	11-7
2 x 10	12.0	14-5
	16.0	16-10
	19.2	15-4
	24.0	13-4
2 x 12	12.0	20-10
	16.0	14-10
	19.2	18-1
	24.0	16-2

NOTES:
The above tables are based on the 2012 New Design Values set forth by Southern Forest Products Association.

- ROOF PLAN NOTES:**
- CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE CODES AT SITE.
 - ALL RIDGE BEAMS, HIP RAFTERS, & VALLEY RAFTERS TO BE 2" X 10" No.2 S.Y.P. OR AS REQD BY ENGINEER.
 - ALL RAFTERS TO BE SIZED AS PER SPAN CHART.
 - CONTRACTOR TO WATERPROOF ALL ROOF INTERSECTIONS AS PER CODE.
 - CONTRACTOR TO VERIFY ALL ROOF PITCHES WITH EXTERIOR ELEVATIONS PRIOR TO CONSTRUCTION.
 - CONTRACTOR TO PROVIDE ADEQUATE ROOF VENTILATION AS REQD BY CURRENT CODES.

CODE DISCLAIMER:
1. THESE PLANS WERE DESIGNED TO MEET IRC 2012 AT THE TIME OF THEIR CREATION AND MORE SPECIFICALLY THE MINIMAL LOCAL CODES OF THE AREA IN WHICH THEY WERE DESIGNED. IT IS HIGHLY RECOMMENDED THAT THESE PLANS BE REVIEWED BY A LOCAL STRUCTURAL ENGINEER PRIOR TO CONSTRUCTION.
2. BEAMS AND FLOOR JOISTS ARE NOT SIZED DUE TO THE MANY GEOGRAPHIC LOCATIONS THESE PLANS ARE SOLD. THESE ITEMS SHALL BE SIZED BY A LOCAL ENGINEER OR MANUFACTURER.
3. ALL CEILING & FLOOR JOISTS (IF CONVENTIONAL FRAMING) SHOULD BE SIZED USING THE LATEST VERSION OF THE IRC OR APPLICABLE CODES AT SITE TO MEET THE LOCAL REQUIREMENTS SUCH AS SNOW LOADS AND OTHER FACTORS. THE CEILING JOISTS SIZES LABELED (IF PRESENT) WERE SIZED USING THE 2012 IRC AT THE TIME OF THEIR CREATION. THEY MUST BE VERIFIED AND MODIFIED AS REQUIRED TO MEET THE LATEST EDITION OF THE (IRC) INTERNATIONAL RESIDENTIAL CODE.
4. ALL FOUNDATIONS AND FOOTING DETAILS SHALL BE REVIEWED AND APPROVED BY A LOCAL ENGINEER.
5. CONTRACTOR SHALL PROVIDE ALL HIGH WIND STRAPPING AND ANCHOR BOLTS AS REQUIRED BY THE LOCAL CODE REQUIREMENTS AND THE LATEST VERSION OF THE IRC.

Website:
Email: sample@sample.com
Phone: 123.456.7891
Fax: 123.456.7891




Pre-Drawn Plan ID:
SAMPLE

Date:
Drawn By:


SHEET NUMBER
7

NOT FOR CONSTRUCTION

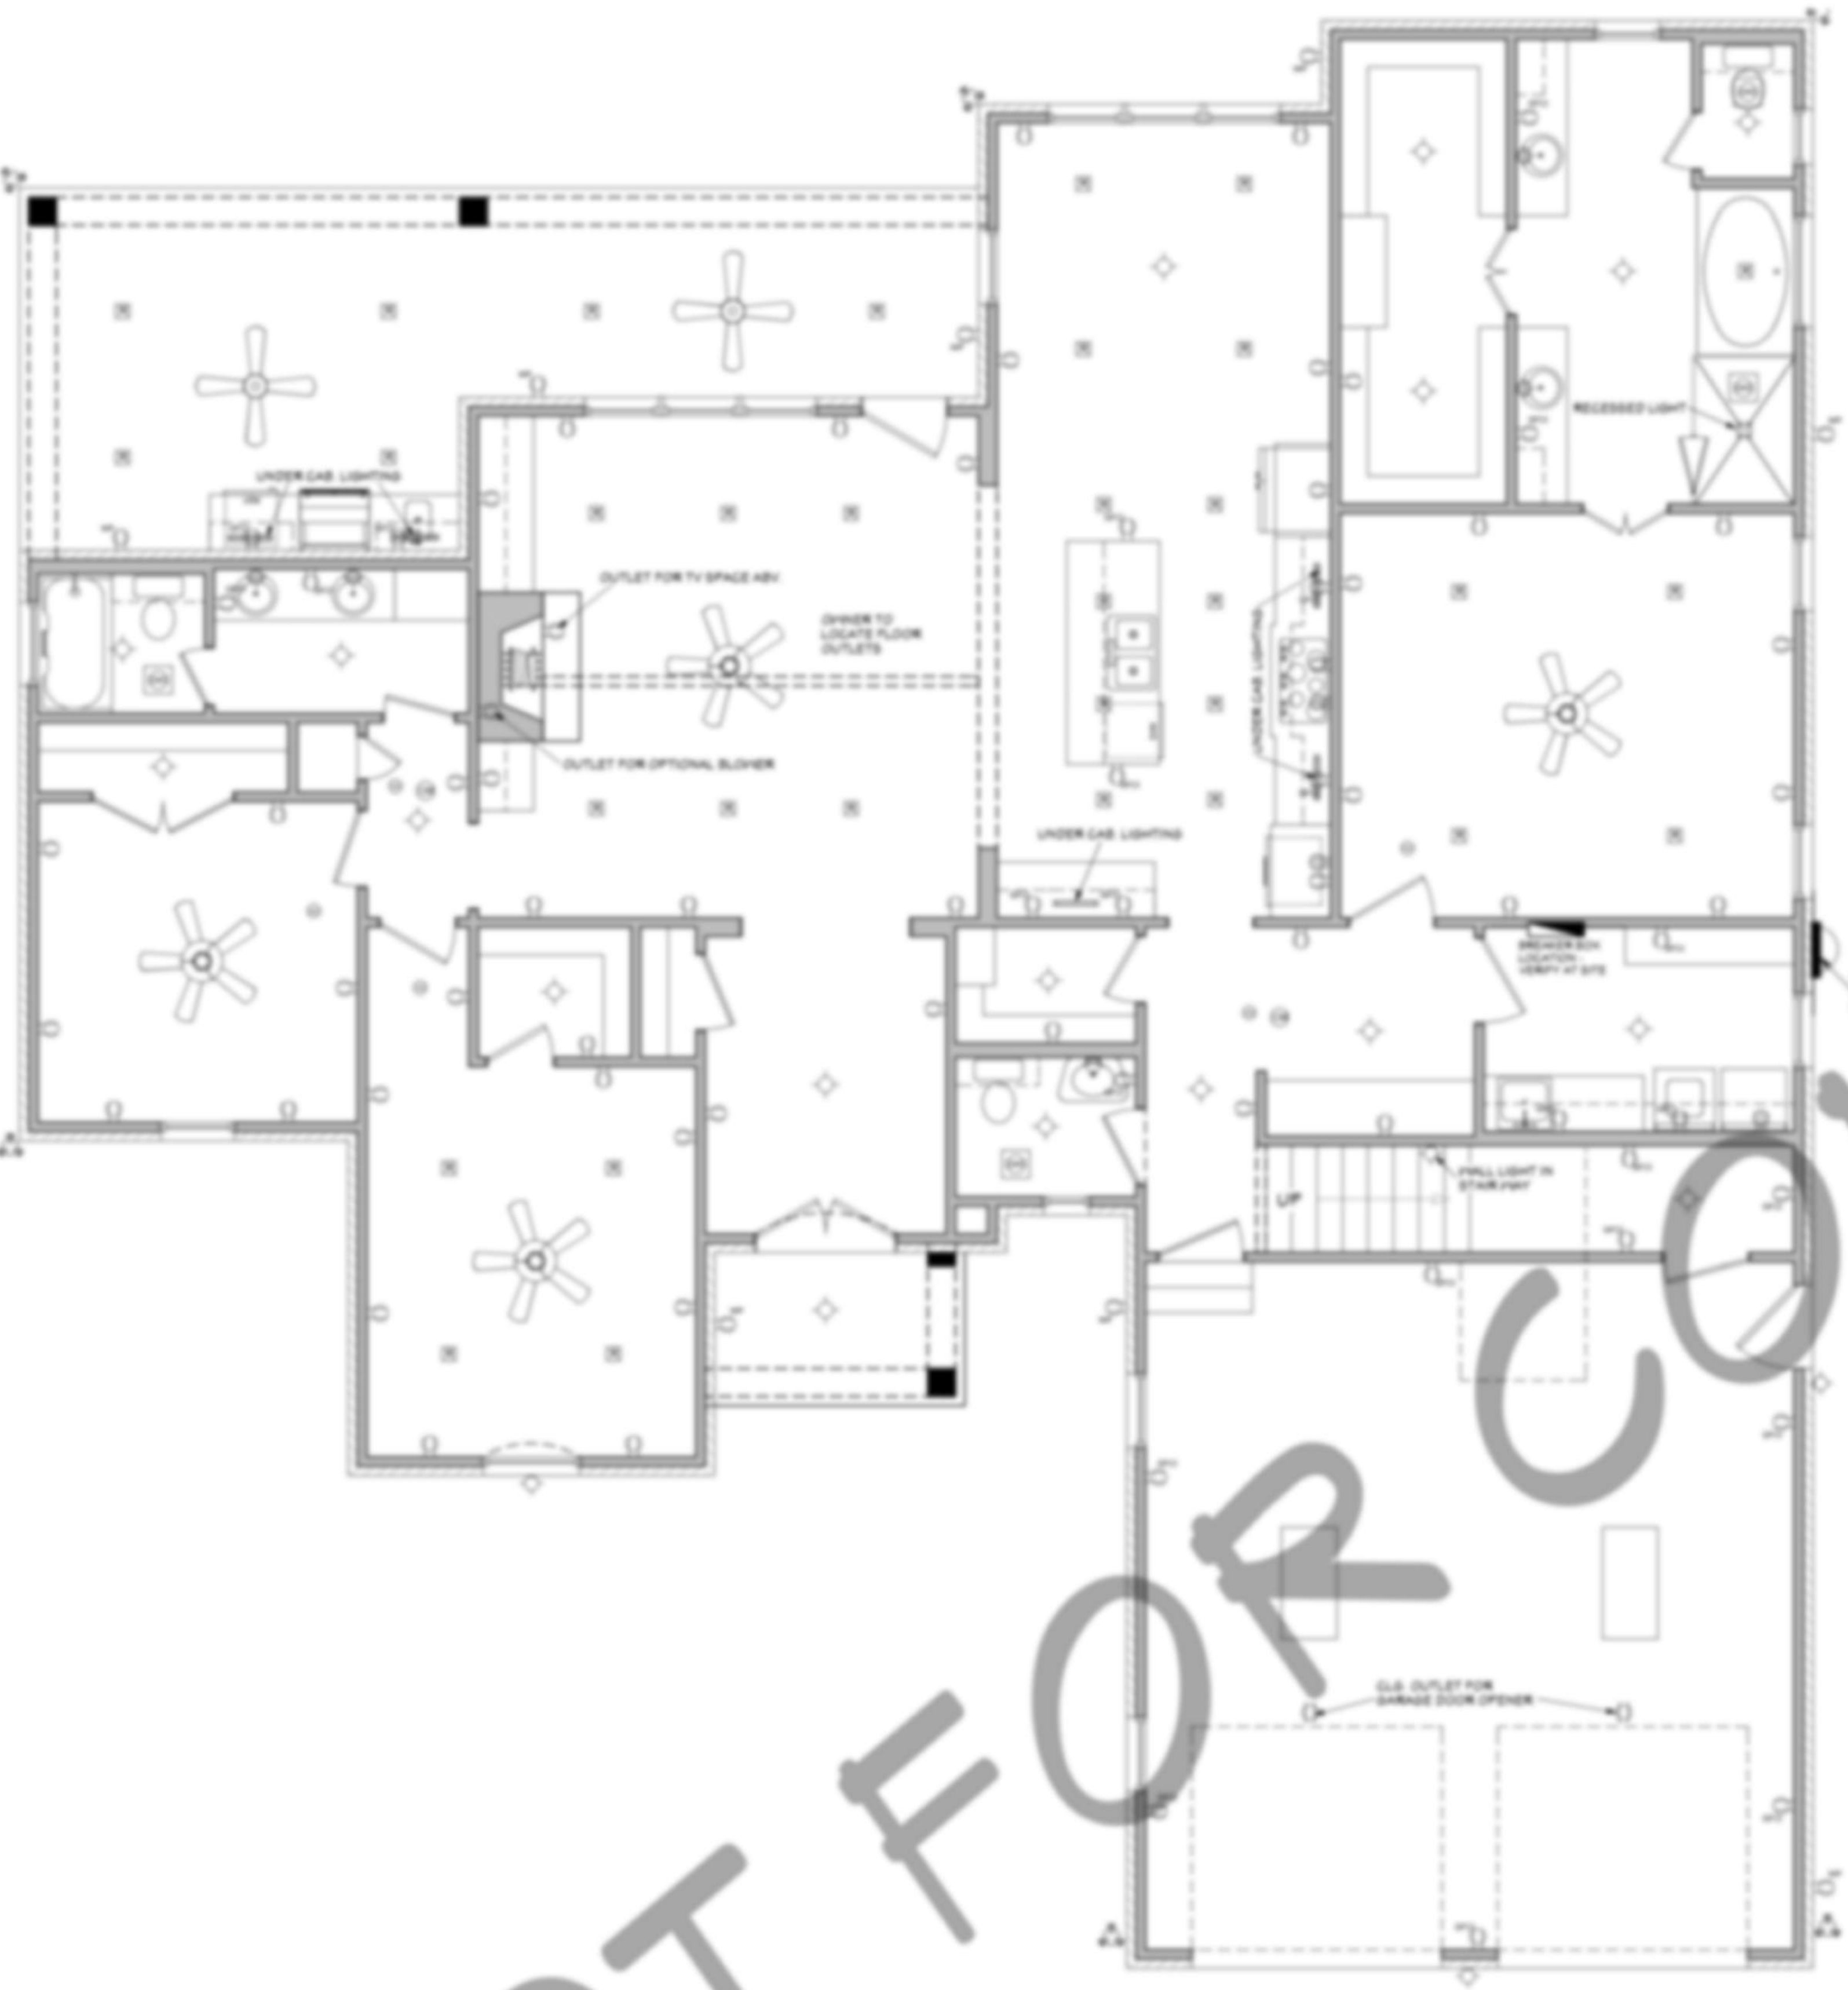

ELECTRICAL SYMBOLS LEGEND	
SYMBOL	DESCRIPTION
	110 VOLT OUTLET
	GROUND FAULT PROTECTED OUTLET
	WEATHERPROOF OUTLET
	220 VOLT RECEPTACLE
	FLOOR OUTLET (OWNER TO LOCATE)
	CEILING HUNG FIXTURE
	OVERHANG MOUNTED FLOODLIGHTS
	WALL MOUNTED FLOODLIGHTS
	RECESSED CEILING FIXTURE
	FLUORESCENT LIGHT
	CARBON MONOXIDE DETECTOR
	SMOKE DETECTOR
	SWITCH
	THREE WAY SWITCH
	WALL MOUNTED LIGHT
	DIMMER SWITCH (OWNER TO LOCATE)
	DOOR ACTIVATED SWITCH
	WEATHERPROOF SWITCH
	CAT5 NETWORKING JACK (OWNER TO LOCATE)
	TELEPHONE OUTLET (OWNER TO LOCATE)
	TELEVISION OUTLET (OWNER TO LOCATE)
	DOORBELL BUTTON (CONTRACTOR TO LOCATE)
	THERMOSTAT (CONTRACTOR TO LOCATE)
	CEILING EXHAUST FAN, VENT TO EXTERIOR
	TV SPEAKER
	RADIO SPEAKER
	CEILING FAN ONLY, NO LIGHT KIT
	CEILING FAN WITH LIGHT KIT
	TRACK LIGHTING (OWNER TO LOCATE)
	WALL SCONCE (OWNER TO LOCATE)
	CHANDELIER 1 (D.T.S.)
	CHANDELIER 2 (D.T.S.)
	UNDER COUNTER LIGHTING
	EMERGENCY LIGHTING/EXIT SIGN

ELECTRICAL NOTES:
 1. ALL WORK SHALL COMPLY WITH ALL CODES APPLICABLE AT SITE.
 2. SMOKE ALARMS SHALL BE INSTALLED IN THE FOLLOWING LOCATIONS: EACH SLEEPING ROOM, OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS, ON EACH ADDITIONAL STORY OF THE DWELLING, INCLUDING BASEMENTS AND HABITABLE ATTIC. WHEN MORE THAN ONE SMOKE ALARM IS REQUIRED TO BE INSTALLED WITHIN A DWELLING THE ALARM DEVICES SHALL BE INTERCONNECTED IN SUCH A MANNER THAT THE ACTIVATION OF ONE ALARM WILL ACTIVATE ALL OF THE ALARMS IN THE UNIT. SMOKE ALARMS SHALL BE HARD WIRED WITH A BATTERY BACK UP.
 3. CARBON MONOXIDE ALARMS SHALL BE INSTALLED OUTSIDE OF EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS IN DWELLING UNITS WITHIN WHICH FUEL-FIRED APPLIANCES ARE INSTALLED AND IN DWELLING UNITS WITH ATTACHED GARAGES.
 4. A 125 VOLT, SINGLE PHASE, 15-20 AMPERE RATED RECEPTACLE OUTLET SHALL BE INSTALLED AT AN ACCESSIBLE LOCATION FOR THE SERVING OF HEATING, AIR CONDITIONING AND REFRIGERATION EQUIPMENT. THE RECEPTACLE SHALL BE LOCATED ON THE SAME LEVEL AND WITHIN 25 FEET OF THE EQUIPMENT. THE RECEPTACLE OUTLET SHALL NOT BE CONNECTED TO THE LOAD SIDE OF THE HVAC EQUIPMENT DISCONNECTING MEANS.

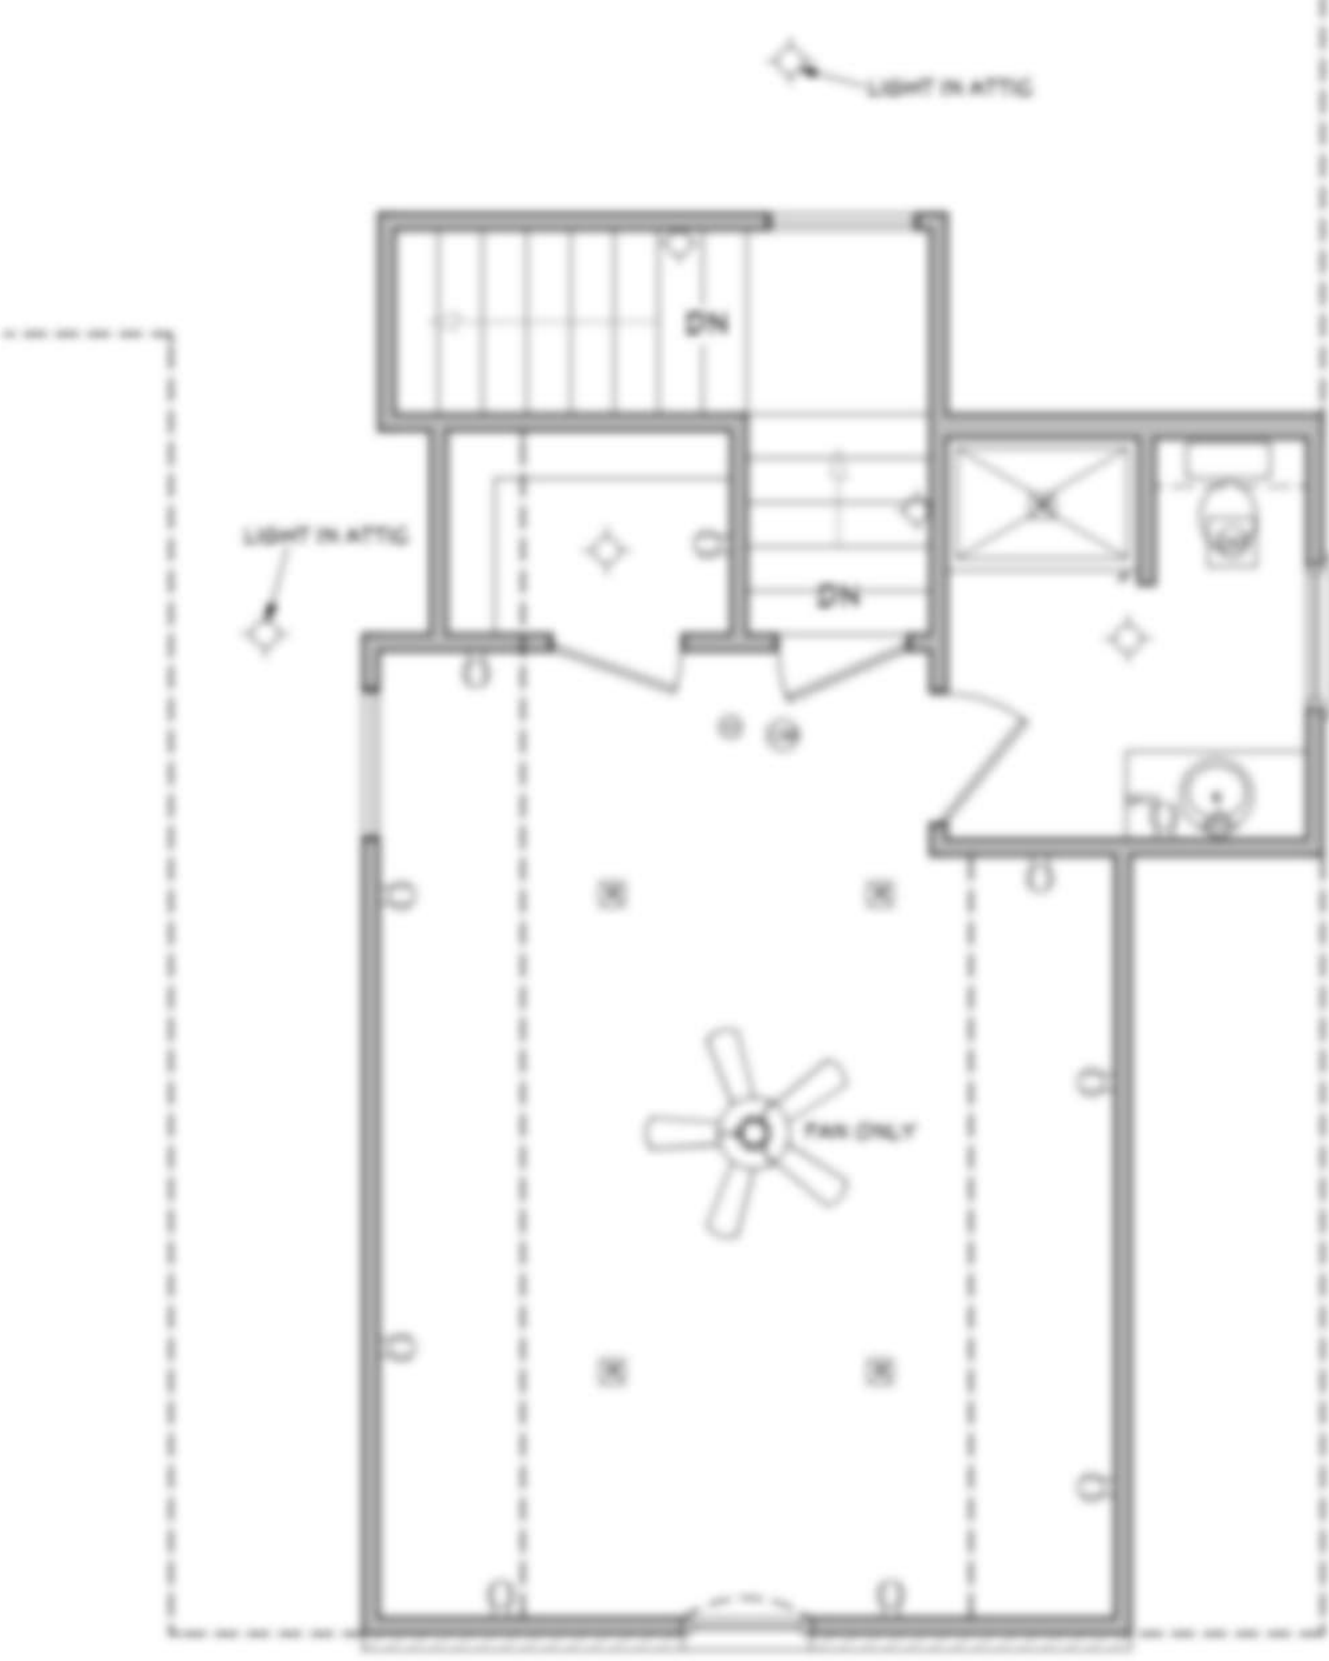

BONUS FLOOR ELECTRICAL PLAN
 SCALE: 1/4" = 1'-0"

ELECTRICAL PLAN
 SCALE: 1/4" = 1'-0"
 NOTE: SWITCHES AND ARCS NOT SHOWN. OWNER TO LOCATE THESE ITEMS DURING ELECTRICAL WALK-THROUGH WITH ELECTRICAL CONTRACTOR.

Website:
 Email: sample@sample.com
 Phone: 123.456.7891
 Fax: 123.456.7891



Pre-Drawn Plan ID:
SAMPLE

Date:
 Drawn By:
 Project Name:

SHEET NUMBER
8